HIGH VOLTAGE SWITCHING STATION BLDG # 71

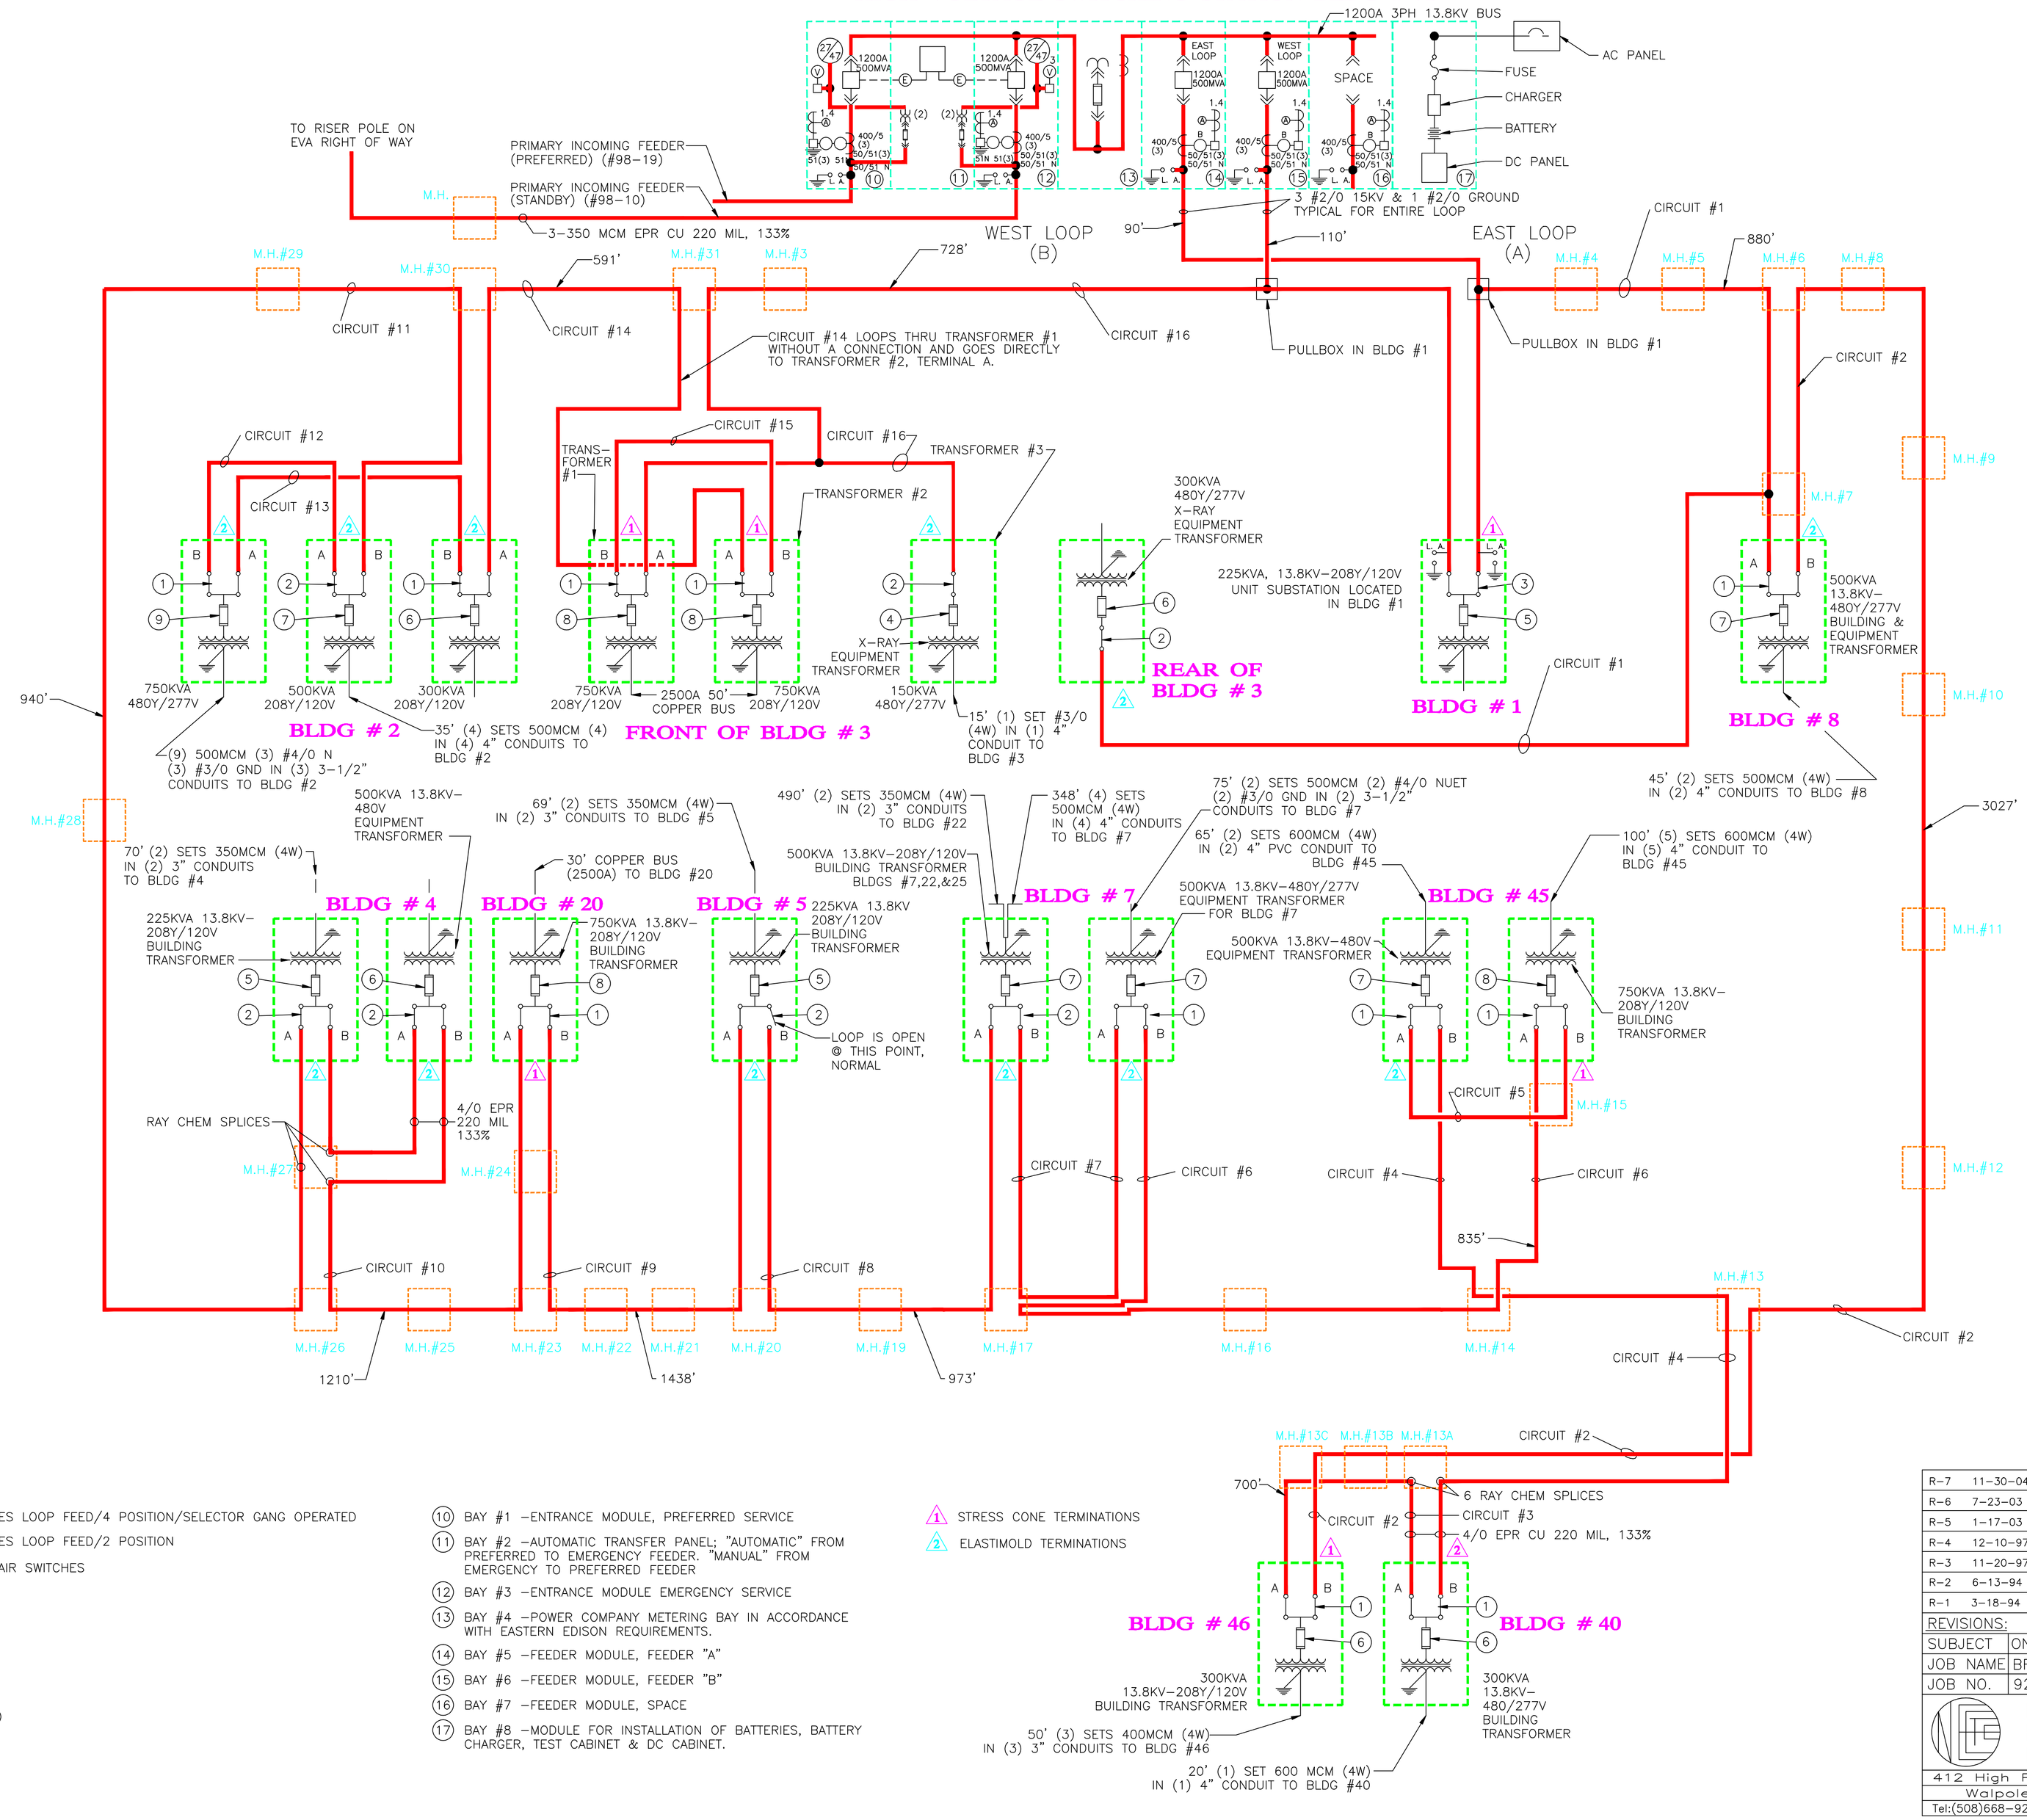

1. OIL SWITCHES LOOP FEED/4 POSITION/SELECTOR GANG OPERATED
2. OIL SWITCHES LOOP FEED/2 POSITION
3. INDIVIDUAL AIR SWITCHES
4. 10A
5. 12A
6. 20A
7. 30A
8. 40A
9. 50A(2-25A)
10. BAY #1 -ENTRANCE MODULE, PREFERRED SERVICE
11. BAY #2 -AUTOMATIC TRANSFER PANEL; "AUTOMATIC" FROM PREFERRED TO EMERGENCY FEEDER. "MANUAL" FROM EMERGENCY TO PREFERRED FEEDER
12. BAY #3 -ENTRANCE MODULE EMERGENCY SERVICE
13. BAY #4 -POWER COMPANY METERING BAY IN ACCORDANCE WITH EASTERN EDISON REQUIREMENTS.
14. BAY #5 -FEEDER MODULE, FEEDER "A"
15. BAY #6 -FEEDER MODULE, FEEDER "B"
16. BAY #7 -FEEDER MODULE, SPACE
17. BAY #8 -MODULE FOR INSTALLATION OF BATTERIES, BATTERY CHARGER, TEST CABINET & DC CABINET.

1. STRESS CONE TERMINATIONS
2. ELASTIMOLD TERMINATIONS

R-7	11-30-04	R.S.H.	AS-BUILT B45 CIRCUIT LAYOUT
R-6	7-23-03	G.S.M.	FLIP/MIRROR B45 CIRCUIT LAYOUT
R-5	1-17-03	G.S.M.	REVISE CIRCUITS #14-16
R-4	12-10-97	G.S.M.	CLOSE SWITCHES
R-3	11-20-97	G.S.M.	ADDITION OF TRANS. AT B4 / REPLACE TRANS. AT B40
R-2	6-13-94	C.M.M.	CAUTION: NOTE TRANS. #'S BEFORE SWITCHING BLDG. #3
R-1	3-18-94	C.M.M.	CIR. #16 FROM TR. #3 CONNECTS TO CIR. #16, NOT CIR.#14

REVISIONS:

SUBJECT	ONE LINE ELECT. DISTRIBUTION DIAGRAM	DRN BY	D.D.
JOB NAME	BROCKTON VA HOSPITAL	SCALE	NONE
JOB NO.	921002	DATE	1/93

New England Electrical Testing Engineers, Inc.
412 High Plain Street, #22
Walpole, MA 02081
Tel:(508)668-9205 Fax:(508)668-2142

VA. PROJECT # 525-91-109

ACAD FILE: 1-L-3042 ON DISK N.E. ELECT. TEST. ENG.