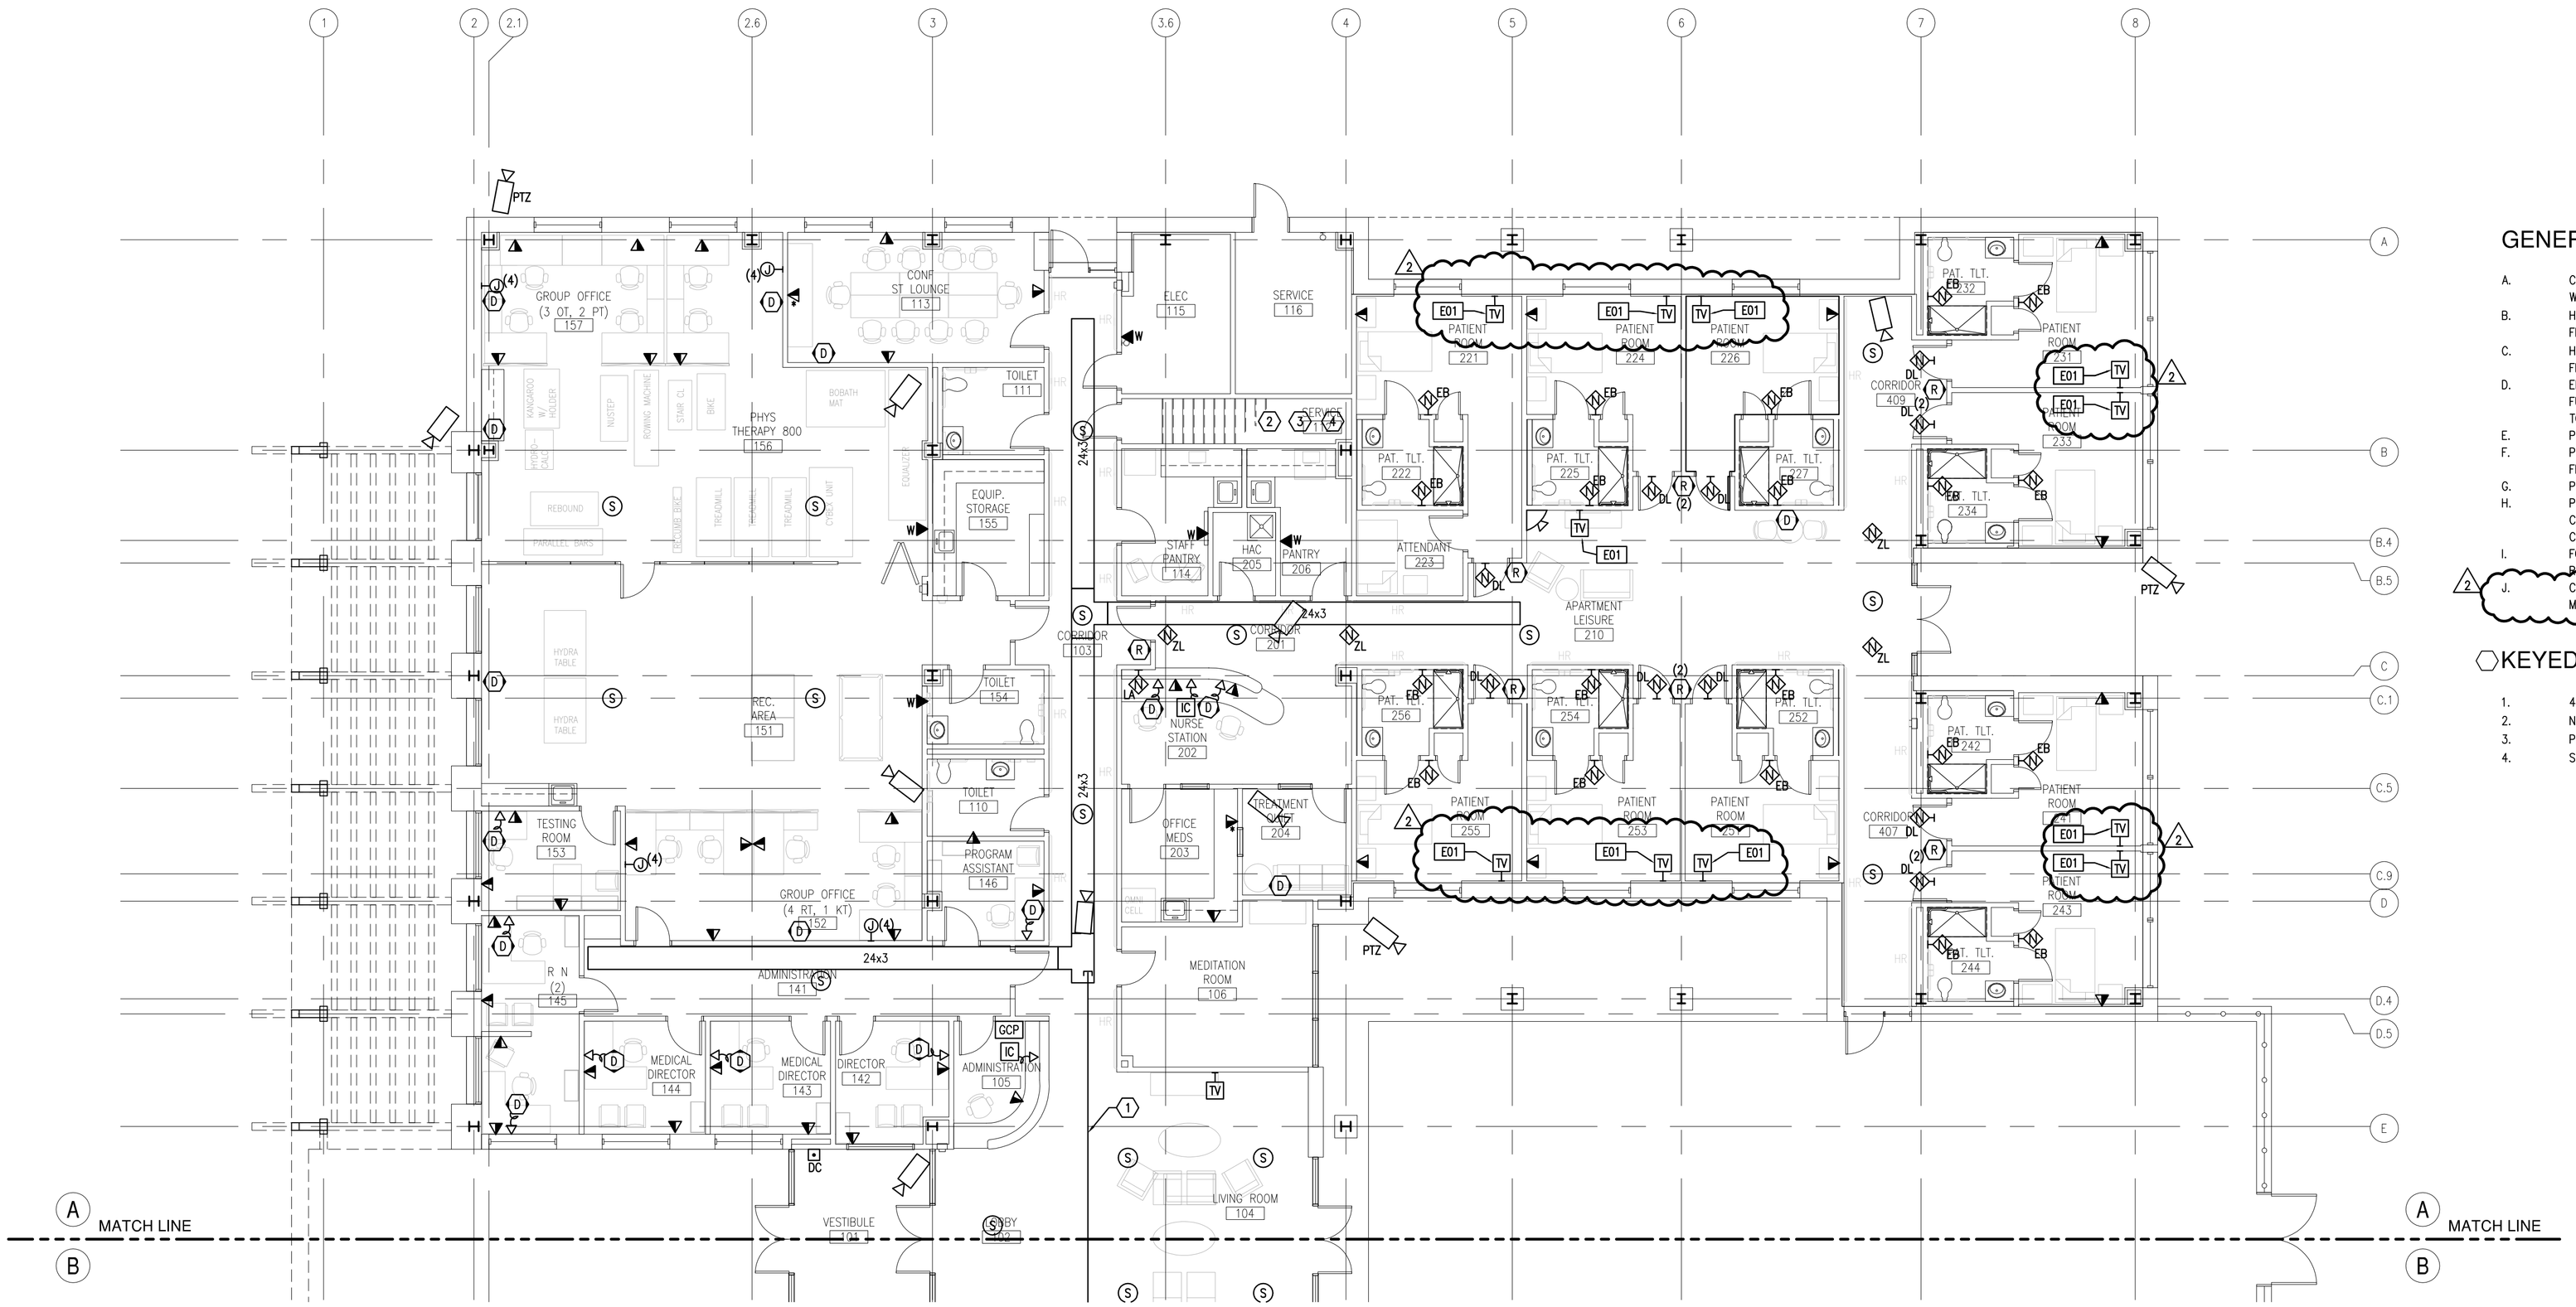

GENERAL NOTES: (AREA "A")

A. COORDINATE ALL CASEWORK MOUNTED DURESS ALARM LOCATIONS WITH OWNER PRIOR TO INSTALLATION.
B. HOMERUN ALL TELE/DATA OUTLETS DEVICES IN AREA A ON THIS FLOOR TO COMM ROOM 130
C. HOMERUN ALL TELE/DATA OUTLETS DEVICES IN AREA B ON THIS FLOOR TO COMM ROOM 130
D. ELECTRICAL CONTRACTOR TO COORDINATE AND FINALIZE ALL SYSTEMS FURNITURE LOCATIONS WITH PURCHASED SYSTEMS FURNITURE PRIOR TO FINAL INSTALLATION OF JUNCTION BOXES.
E. PROVIDE CONDUIT AS SHOWN OVER HARD CEILING AREAS.
F. PROVIDE 48 INCH RADIUS SWEEPS FOR CONDUIT TURNS EXITING FROM COMM ROOM
G. PROVIDE PULL STRINGS IN ALL CONDUITS.
H. PROVIDE COMPRESSION FITTINGS FOR ALL CONNECTIONS OF ALL CONDUITS IN HARD AREA. REMOVE ALL BURS FROM CONDUIT ANY CUTS.
I. FOR ALL CARD READERS REFER TO SHEET ES4-107 FOR CONDUIT ROUGH-IN DETAIL.
2 J. COORDINATE LOCATION OF TV OUTLET WITH POWER OUTLET AND TV MOUNTING BRACKET.

KEYED NOTES:

1. 4-4"C. WITH PULL STRING.
2. NURSE CALL SYSTEM PANEL (BY OTHERS).
3. PUBLIC ADDRESS SYSTEM HEAD END (BY OTHERS).
4. SECURITY HEAD END (BY OTHERS).

1 PARTIAL FLOOR SIGNAL PLAN - AREA A
1/8" = 1'-0"



KEY PLAN

PLAN NORTH

FULLY SPRINKLERED

Revisions:	Date
1 Amendment 1	09/11/08
1 Bulletin 6	06/04/09

CONSULTANTS:

ARCHITECT/ENGINEERS:

HDR Architecture, Inc
1101 King Street | Suite 400 | Alexandria, Virginia 22314-2944 | 703.518.8500
5426 Bay Center Drive | Suite 400 | Tampa, Florida 33609-3444 | 813.282.2493

Drawing Title: FIRST FLOOR SIGNAL PLAN AREA A

Approved: Project Director

Project Title: V.A. RICHMOND POLYTRAUMA TRANSITIONAL REHABILITATION CENTER

Location: HUNTER HOLMES McGUIRE

Date: 07/24/2008 | Checked | Drawn

Project Number: V101BP 0241 652-307

Building Number

Drawing Number: ES1-301

Dwg. of

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978