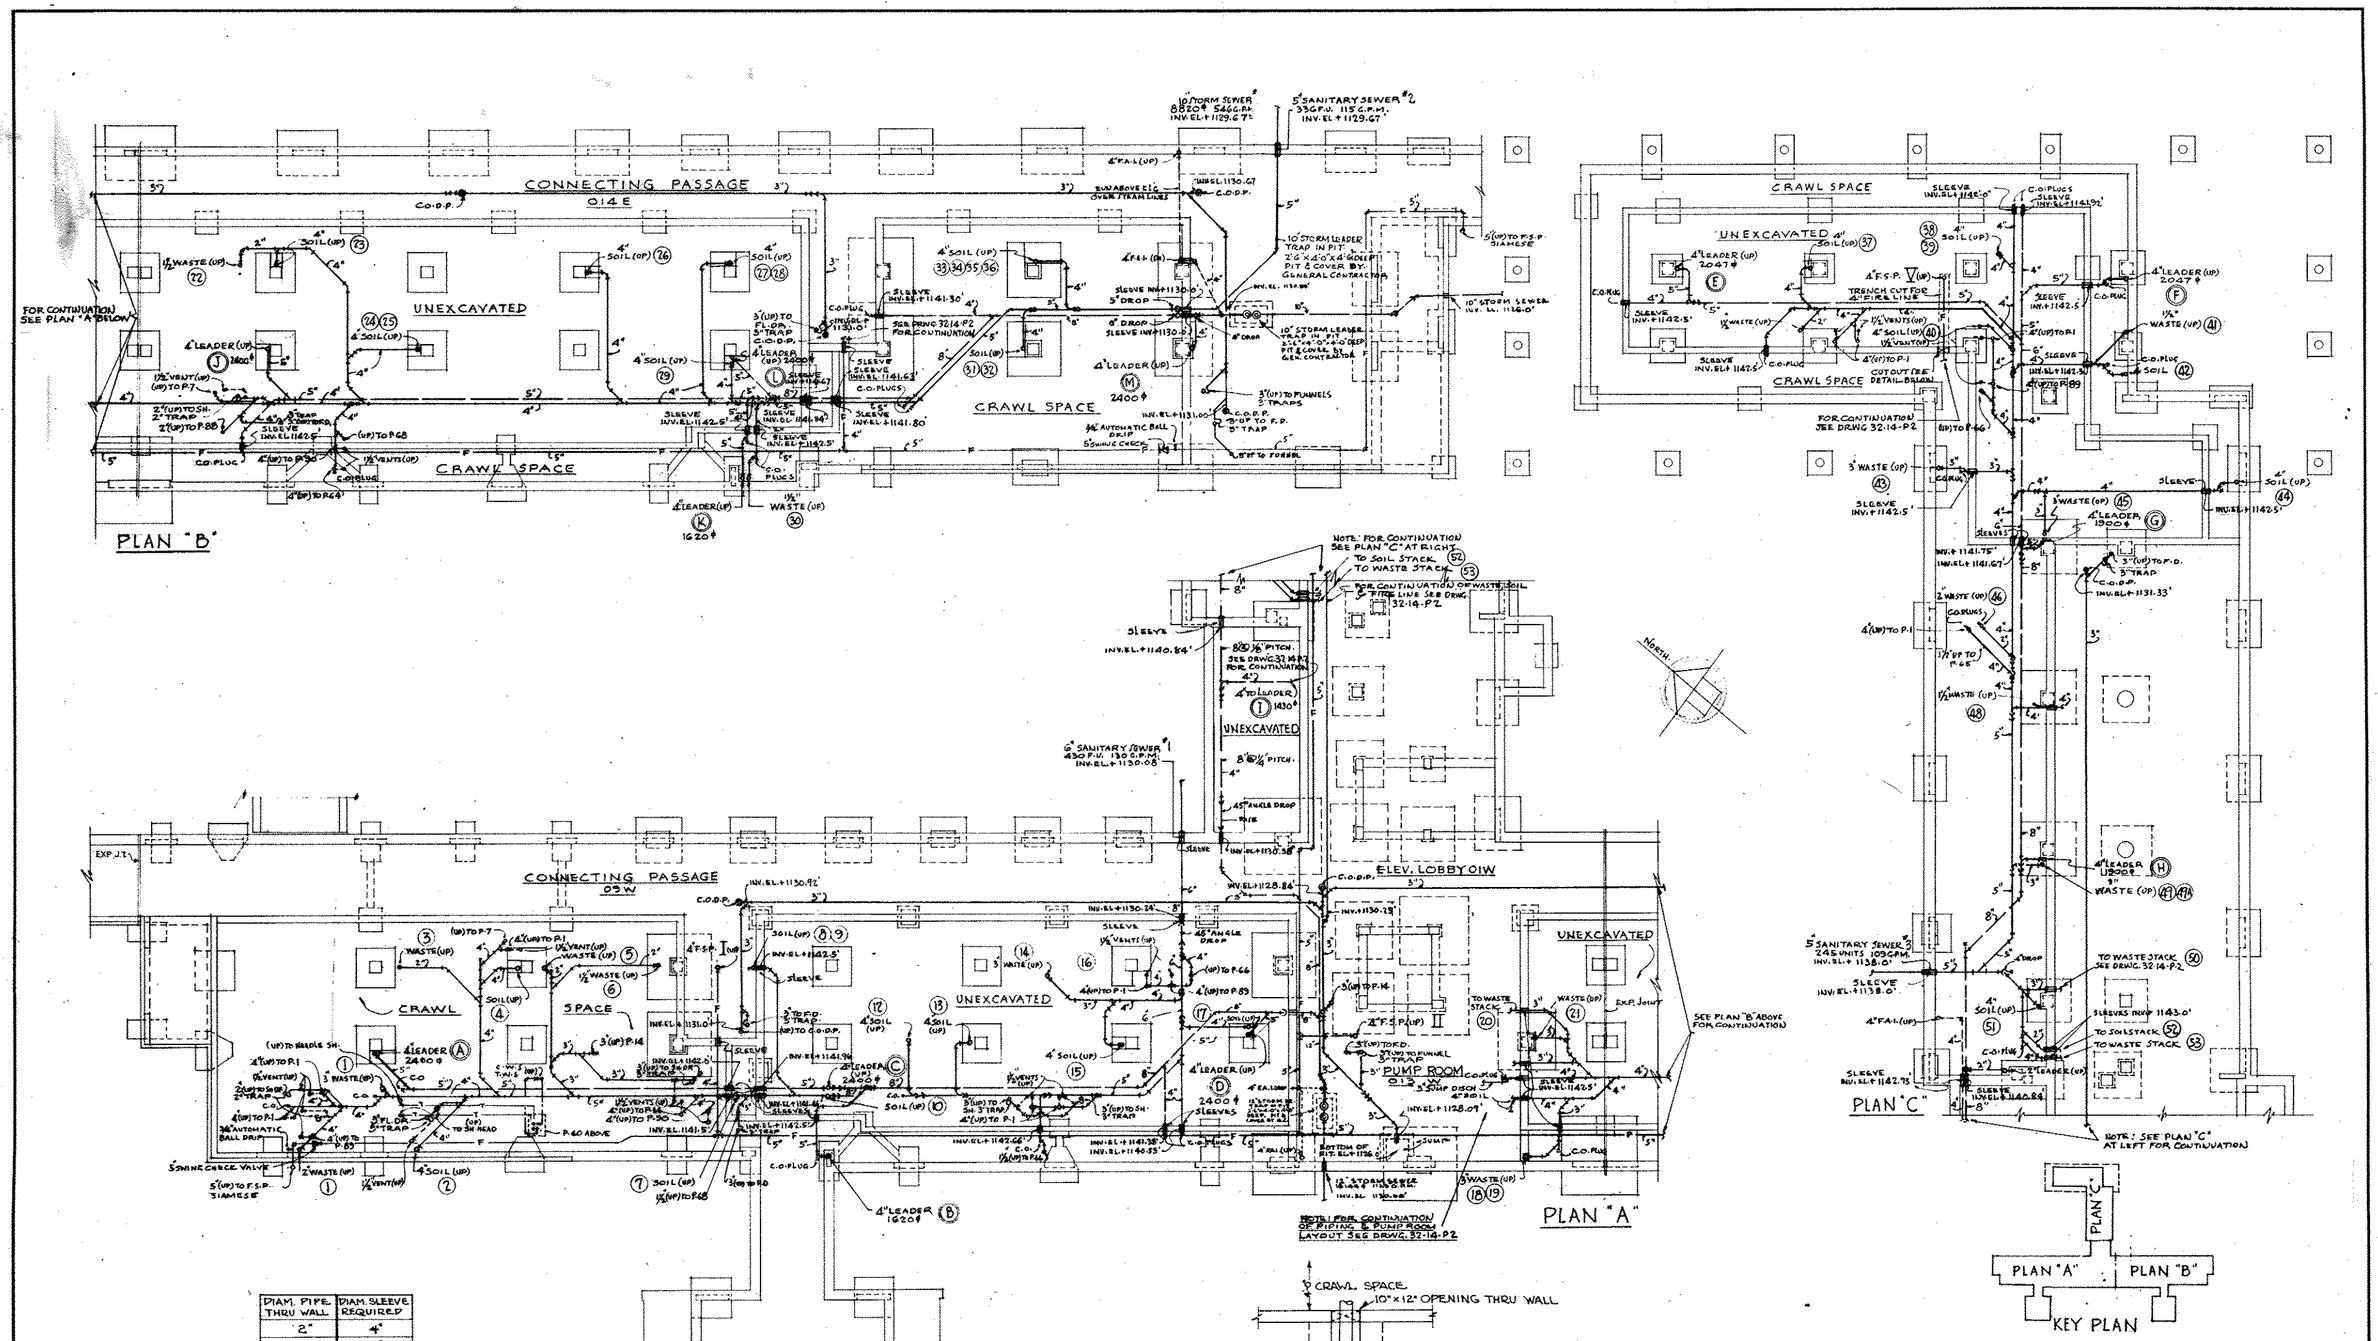

DIAM. PIPE THRU WALL	DIAM. SLEEVE REQUIRED
2"	4"
3"	5"
4"	6"
5"	8"
6"	8"
8"	10"
10"	12"

NOTE: SLEEVES WHERE INDICATED SHALL BE FURNISHED & SET BY THE PLUMBING CONT. TO CONFORM TO THE ELEVATIONS NOTED ON DRAW'GS. ELEVATIONS REFER TO INVERTS OF SANITARY & STORM SYSTEM DRAINS.

PIPE SLEEVE SCHEDULE

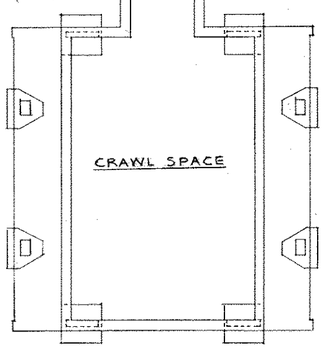

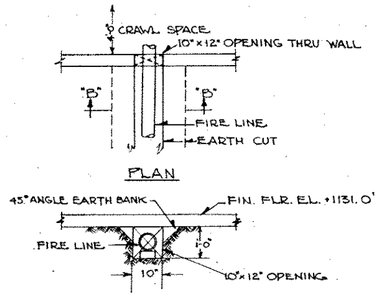

DETAIL OF FIRE LINE TRENCH

SCALE 1/2" = 1'-0"

FOR GENERAL NOTES SEE SHEET 32-14-P3

GRAPHIC SCALE 1/8" = 1'-0"

REVISION	DATE	DESCRIPTION	BY

PRACK & PRACK
ALFRED HOPKINS & ASSOCIATES
BOWERS & BARBALAT
ARCHITECTS - ENGINEERS

DEPARTMENT OF THE ARMY
CORPS OF ENGINEERS
PITTSBURGH DISTRICT
PITTSBURGH, PA.

DRAWN BY: W.C.K.
TRACED BY: W.C.K.
CHECKED BY:
SUBMITTED:
APPROVED:
ENGINEER
APPROVED:
COL. C. E. DISTRICT ENGINEER
DATE:

VETERANS ADMINISTRATION HOSPITAL
PITTSBURGH, PA.
[redacted] BED N. P.
BUILDING 2 - ADMISSION & TREATMENT
DRAINAGE PLAN

V.A. PROJECT NO. 2447

SCALE 1/8" = 1'-0" SPEC. NO.
DRAWING NUMBER
SHEET OF 32-14-P1