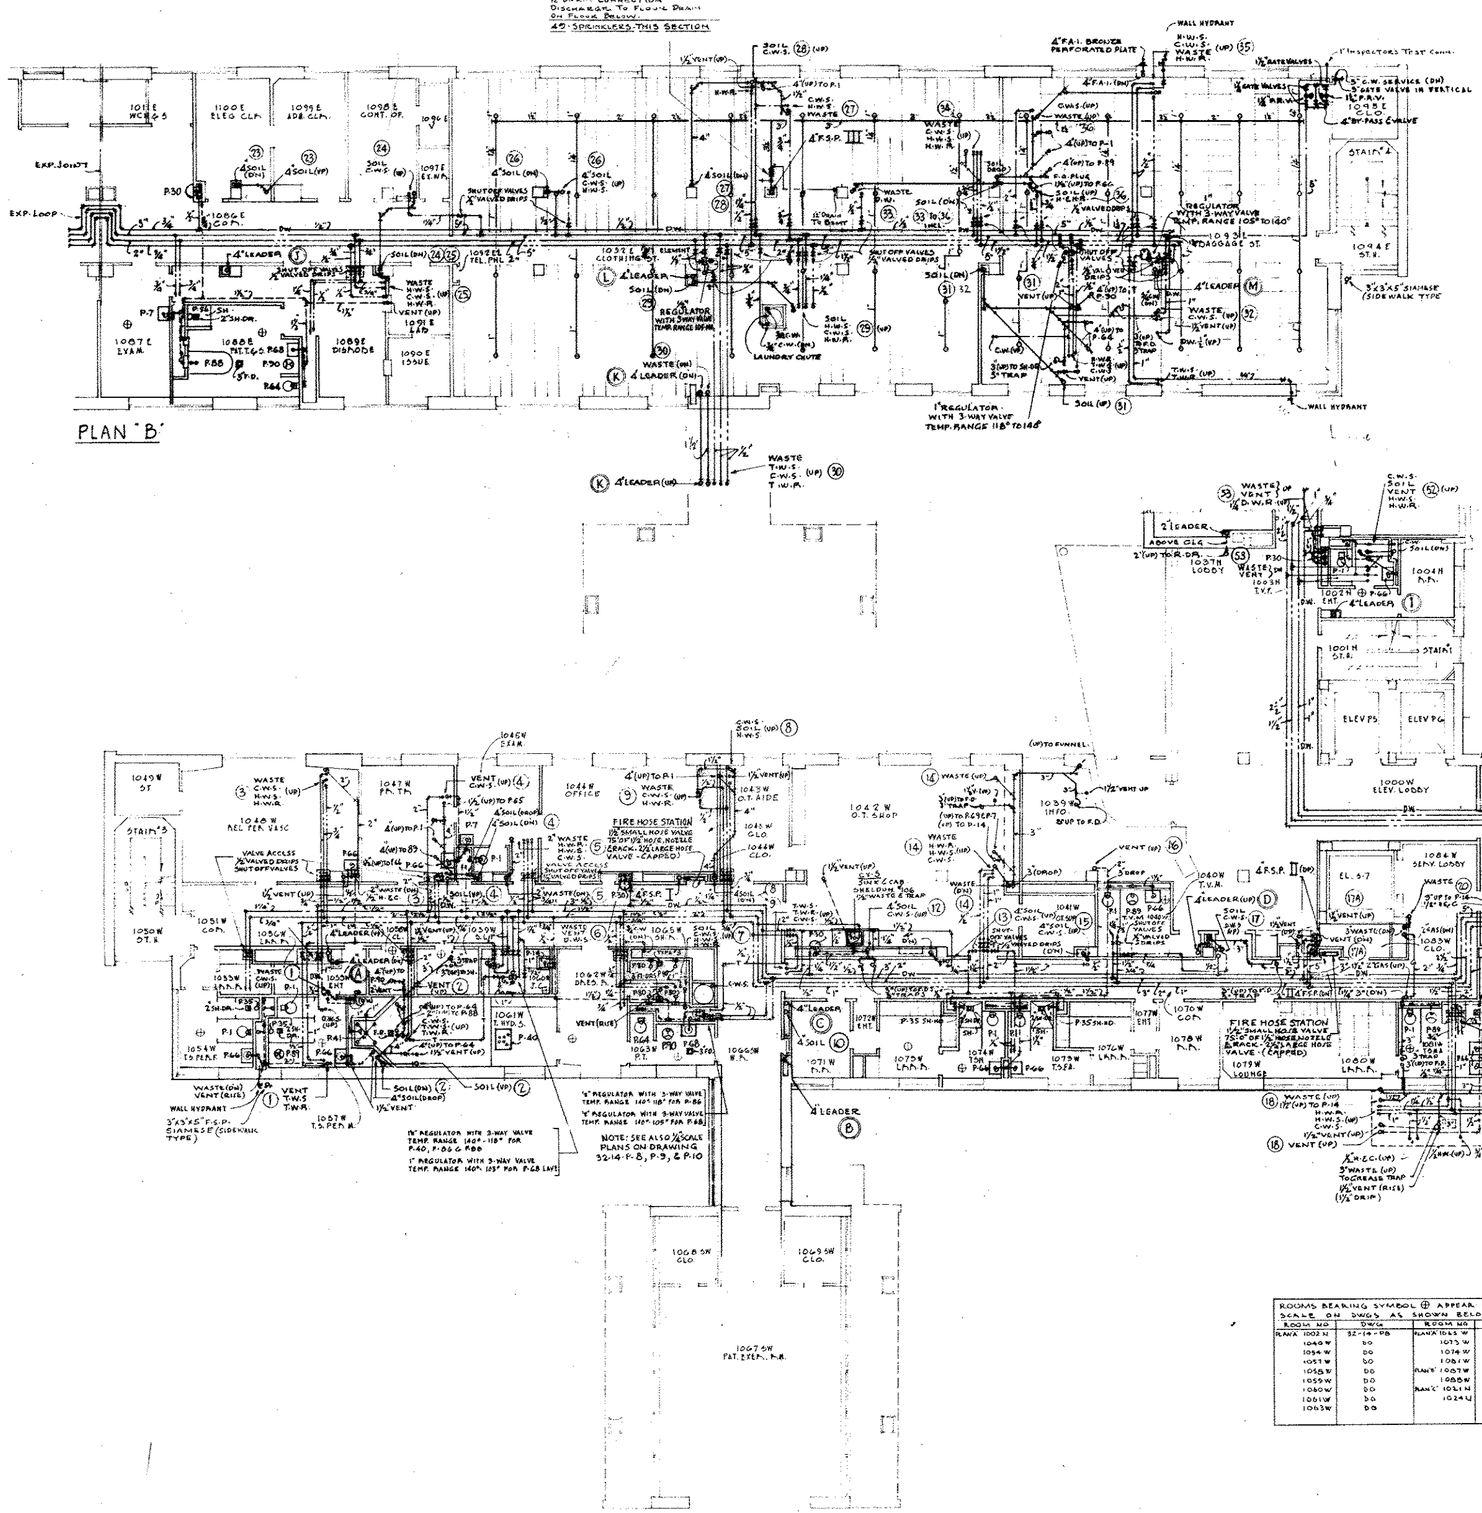

CONNECT 8" SPRINKLER SUPPLY TO 4" FIRE STANDPIPE LINE. INSTALL 2" O.S. & Y. VALVE. 2½" WATER FLOW INDICATOR. ½" DRAIN CONNECTION DISCHARGE TO FLOOR DRAIN ON FLOOR BELOW.
4" SPRINKLERS THIS SECTION

GENERAL NOTE: FOR FIXTURE ROUGHING BRANCHES FOR SOIL, WASTE, VENT, WATER, ETC., SEE 1/4 SCALE DRWGS NOS. 32-14-P.6, P.9, & P.10

FOR MISCELLANEOUS DETAILS, FIXTURE MOUNTING HEIGHTS, ETC., SEE DRWGS 40-13-P1 & 40-13-P2

(SEE ALSO SHEET 32-14-P13)

FLOOR DRAINS IN PATIENTS TOILET ROOMS SHALL BE JOSAM MFG. CO. 303-C OR EQUAL WITH TAMPER PROOF SCREWS.
FLOOR DRAINS IN SECLUSION ROOMS SHALL BE JOSAM MFG. CO. 39FQ OR EQUAL WITH HAGSTROM LOCKS OR EQUAL.

FOR GENERAL DETAILS AUX. & SERV. KITCHEN EQUIPMENT SEE ARCHITECTS DRWG 40-01-A46.
FOR GENERAL DETAILS CABINETS SEE ARCHITECTS DRWG 40-01-A45.

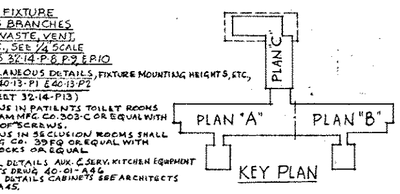

ROOMS BEARING SYMBOL ⊕ APPEAR AT LARGER SCALE ON DWGS AS SHOWN BELOW

ROOM NO.	DWG.	ROOM NO.	DWG.
RANK 1002 N	32-14-P8	RANK 1045 W	32-14-P8
1040 W	DO	1073 W	DO
1054 W	DO	1074 W	DO
1057 W	DO	1081 W	DO
1058 W	DO	RANK 1067 W	DO
1059 W	DO	1068 W	DO
1060 W	DO	RANK 1011 N	DO
1061 W	DO	1024 U	DO
1063 W	DO		

GRAPHIC SCALE 20 15 10 5 0 4 — 1/8" = 1'-0"

REVISION	DATE	DESCRIPTION	BY

PRACK & PRACK
ALFRED HOPKINS & ASSOCIATES
BOWERS & BARBALAT
ARCHITECTS - ENGINEERS

DEPARTMENT OF THE ARMY
CORPS OF ENGINEERS
PITTSBURGH DISTRICT
PITTSBURGH, PA.

DRAWN BY: W.C.K.
TRACED BY: W.C.K.
CHECKED BY:
SUBMITTED:
APPROVED: ENGINEER
APPROVED: COL. C. E. DISTRICT ENGINEER
DATE:

VETERANS ADMINISTRATION HOSPITAL
PITTSBURGH, PA.
BED N. P.
BUILDING 2 - ADMISSION & TREATMENT
FIRST FLOOR PLAN

V.A. PROJECT NO. 2447

SCALE 1/8" = 1'-0" | SPEC. NO.
DRAWING NUMBER
SHEET OF 32-14-P3