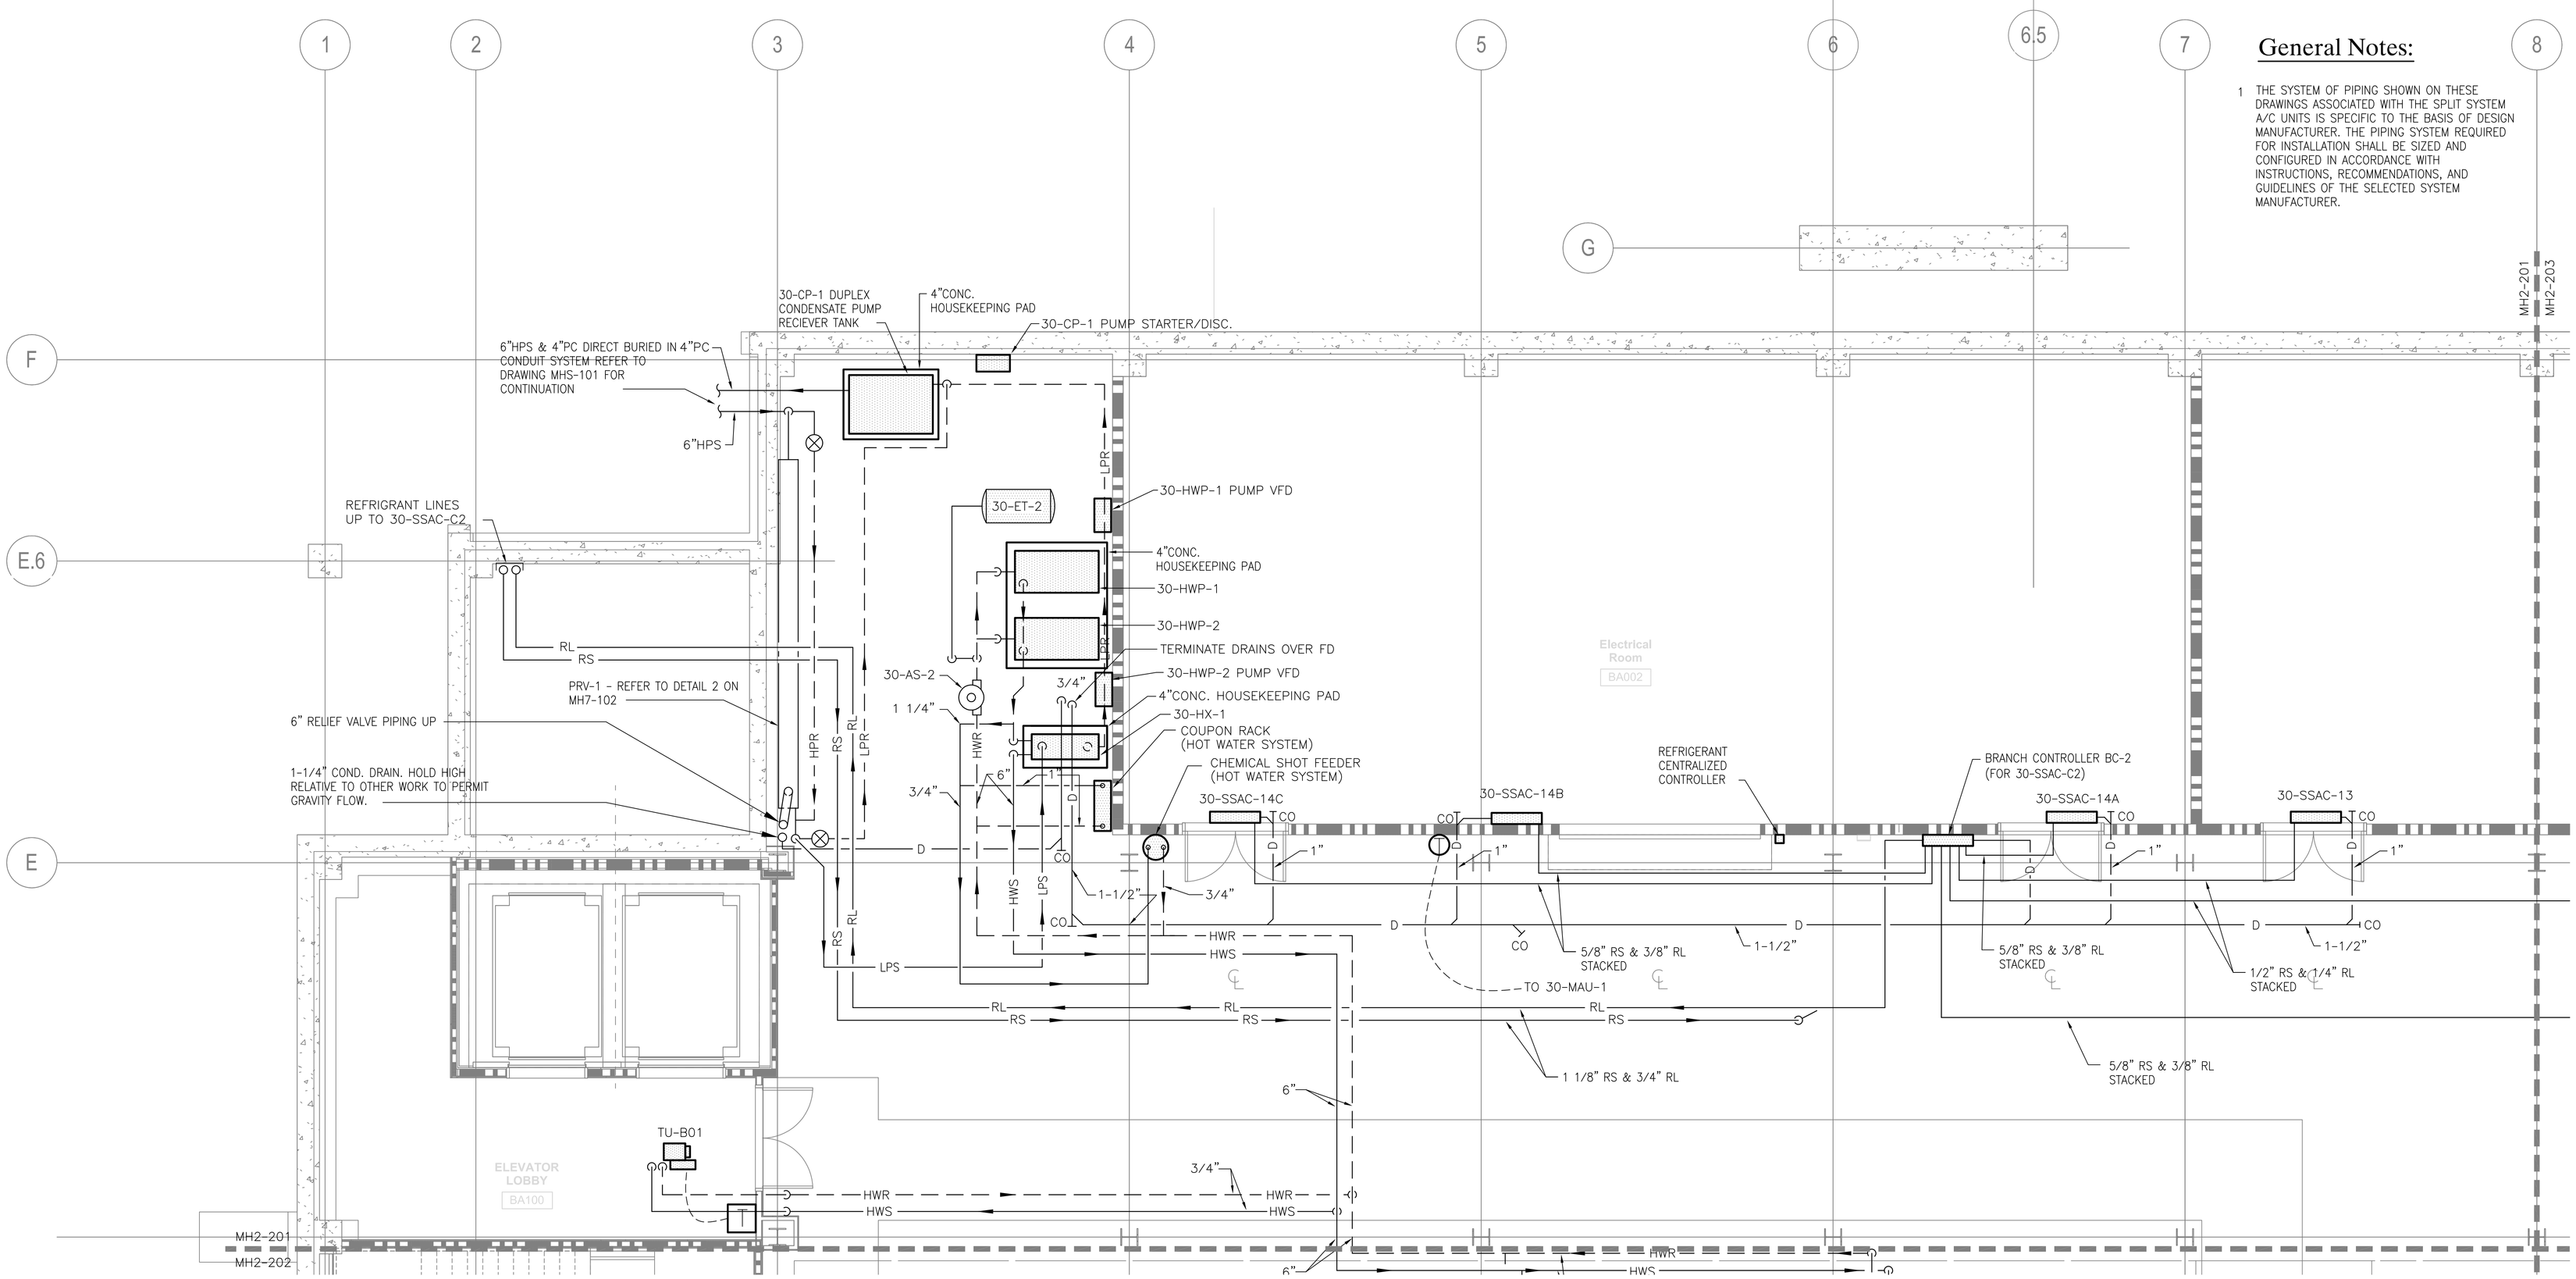

General Notes:

1 THE SYSTEM OF PIPING SHOWN ON THESE DRAWINGS ASSOCIATED WITH THE SPLIT SYSTEM A/C UNITS IS SPECIFIC TO THE BASIS OF DESIGN MANUFACTURER. THE PIPING SYSTEM REQUIRED FOR INSTALLATION SHALL BE SIZED AND CONFIGURED IN ACCORDANCE WITH INSTRUCTIONS, RECOMMENDATIONS, AND GUIDELINES OF THE SELECTED SYSTEM MANUFACTURER.

1 Enlarged Basement Floor Plan - HVAC Piping
SCALE: 1/4"=1'-0"

FOR CONSTRUCTION
FULLY SPRINKLERED

CONSULTANTS:

HDR Architecture, Inc.
1101 King Street | Suite 400 | Alexandria, Virginia 22314-2944 | 703.518.8500

Revisions: | **Date**

ARCHITECT/ENGINEERS:

ARCHITECTURE ENGINEERING INTERIOR DESIGN DESIGN/BUILD
ASTORINO
227 Fort Pitt Boulevard Pittsburgh Pennsylvania 15222
TEL 412 765 3700 FAX 412 765 1731 www.astorino.com

Drawing Title	Enlarged Basement Floor Plan HVAC Piping
Approved: Project Director	
Project Title	VA CARES CONSOLIDATION VAMC, PITTSBURGH, PA RESEARCH OFFICE BLDG.
Project Number	646CA2500R
Building Number	30
Location	VAPHS UNIVERSITY DRIVE
Date	08-18-10
Checked	JS
Drawn	RAN
Drawing Number	MH2-201
Dwg. -- of --	

Office of Facilities Management
Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

P:\Project\20054250.00\CAD\UNIVERSITY DRIVE\Research Office Building\HVAC\MH2-201.dwg MBESHENCH 07/14/09 ; 14:15:16