Key Notes

1. SMOKE DETECTOR WILL INITIATE THE ELEVATOR RECALL.
2. SMOKE DETECTOR AND/OR HEAT DETECTOR WILL INITIATE THE ELEVATOR RECALL.
3. PROVIDE ONE HEAT DETECTOR FOR EACH INSTALLED SPRINKLER HEAD.

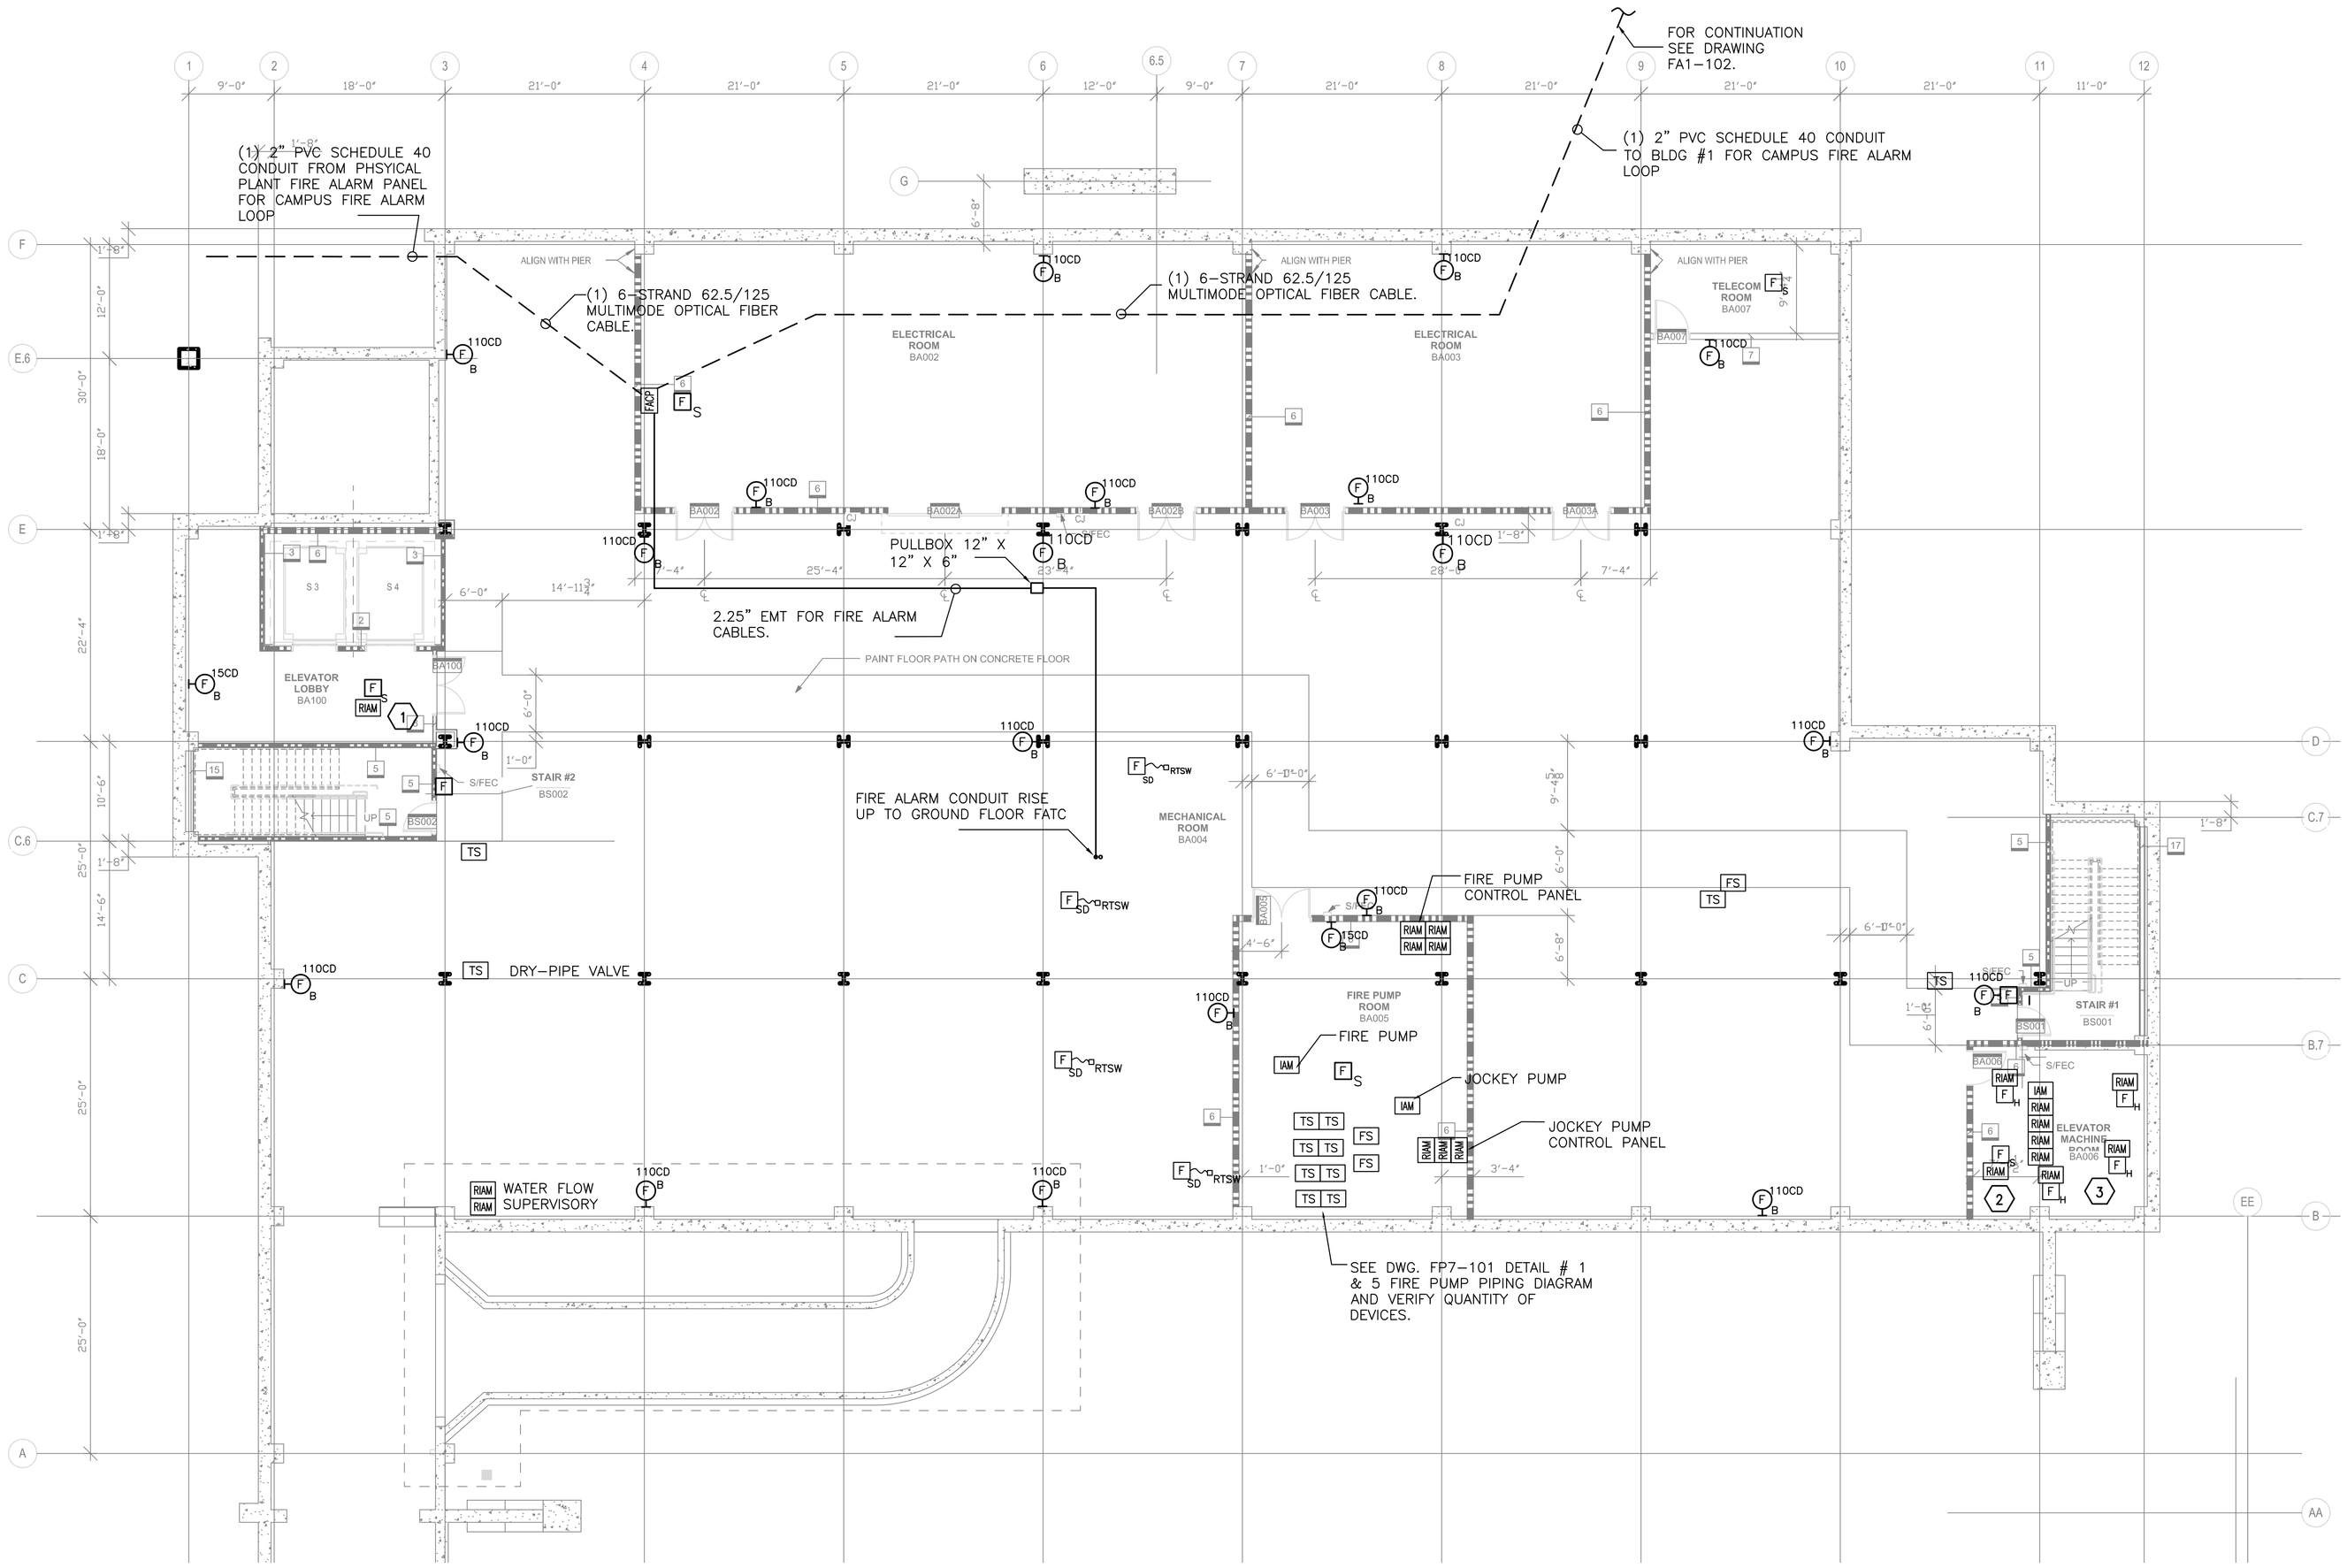

1 Fire Alarm - Basement Plan
SCALE: 1/8"=1'-0"

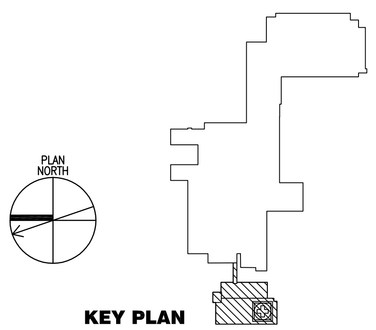

KEY PLAN

FOR CONSTRUCTION
FULLY SPRINKLERED

Revisions:	Date

CONSULTANTS:

HDR Architecture, Inc.
1101 King Street | Suite 400 | Alexandria, Virginia 22314-2944 | 703.518.8500

ARCHITECT/ENGINEERS:

ARCHITECTURE ENGINEERING INTERIOR DESIGN DESIGN/BUILD
ASTORINO
227 Fort Pitt Boulevard Pittsburgh Pennsylvania 15222
TEL 412 765 1700 FAX 412 765 1711 www.astorino.com

Drawing Title	Fire Alarm Basement Floor Plan
Approved: Project Director	
Project Title	VA CARES CONSOLIDATION VAMC, PITTSBURGH, PA RESEARCH OFFICE BLDG.
Project Number	646CA2500R
Building Number	30
Location	VAPHS UNIVERSITY DRIVE
Date	08-18-10
Checked	REM
Drawn	JMG
Drawing Number	FA1-101
Dwg. x of x	

Office of Facilities Management
Department of Veterans Affairs

VA FORM 08-6231, OCT 1978