Key Notes

1. SMOKE DETECTOR WILL INITIATE THE ELEVATOR RECALL.
2. SMOKE DETECTOR AND/OR HEAT DETECTOR WILL INITIATE THE ELEVATOR RECALL.
3. PROVIDE ONE HEAT DETECTOR FOR EACH INSTALLED SPRINKLER HEAD.

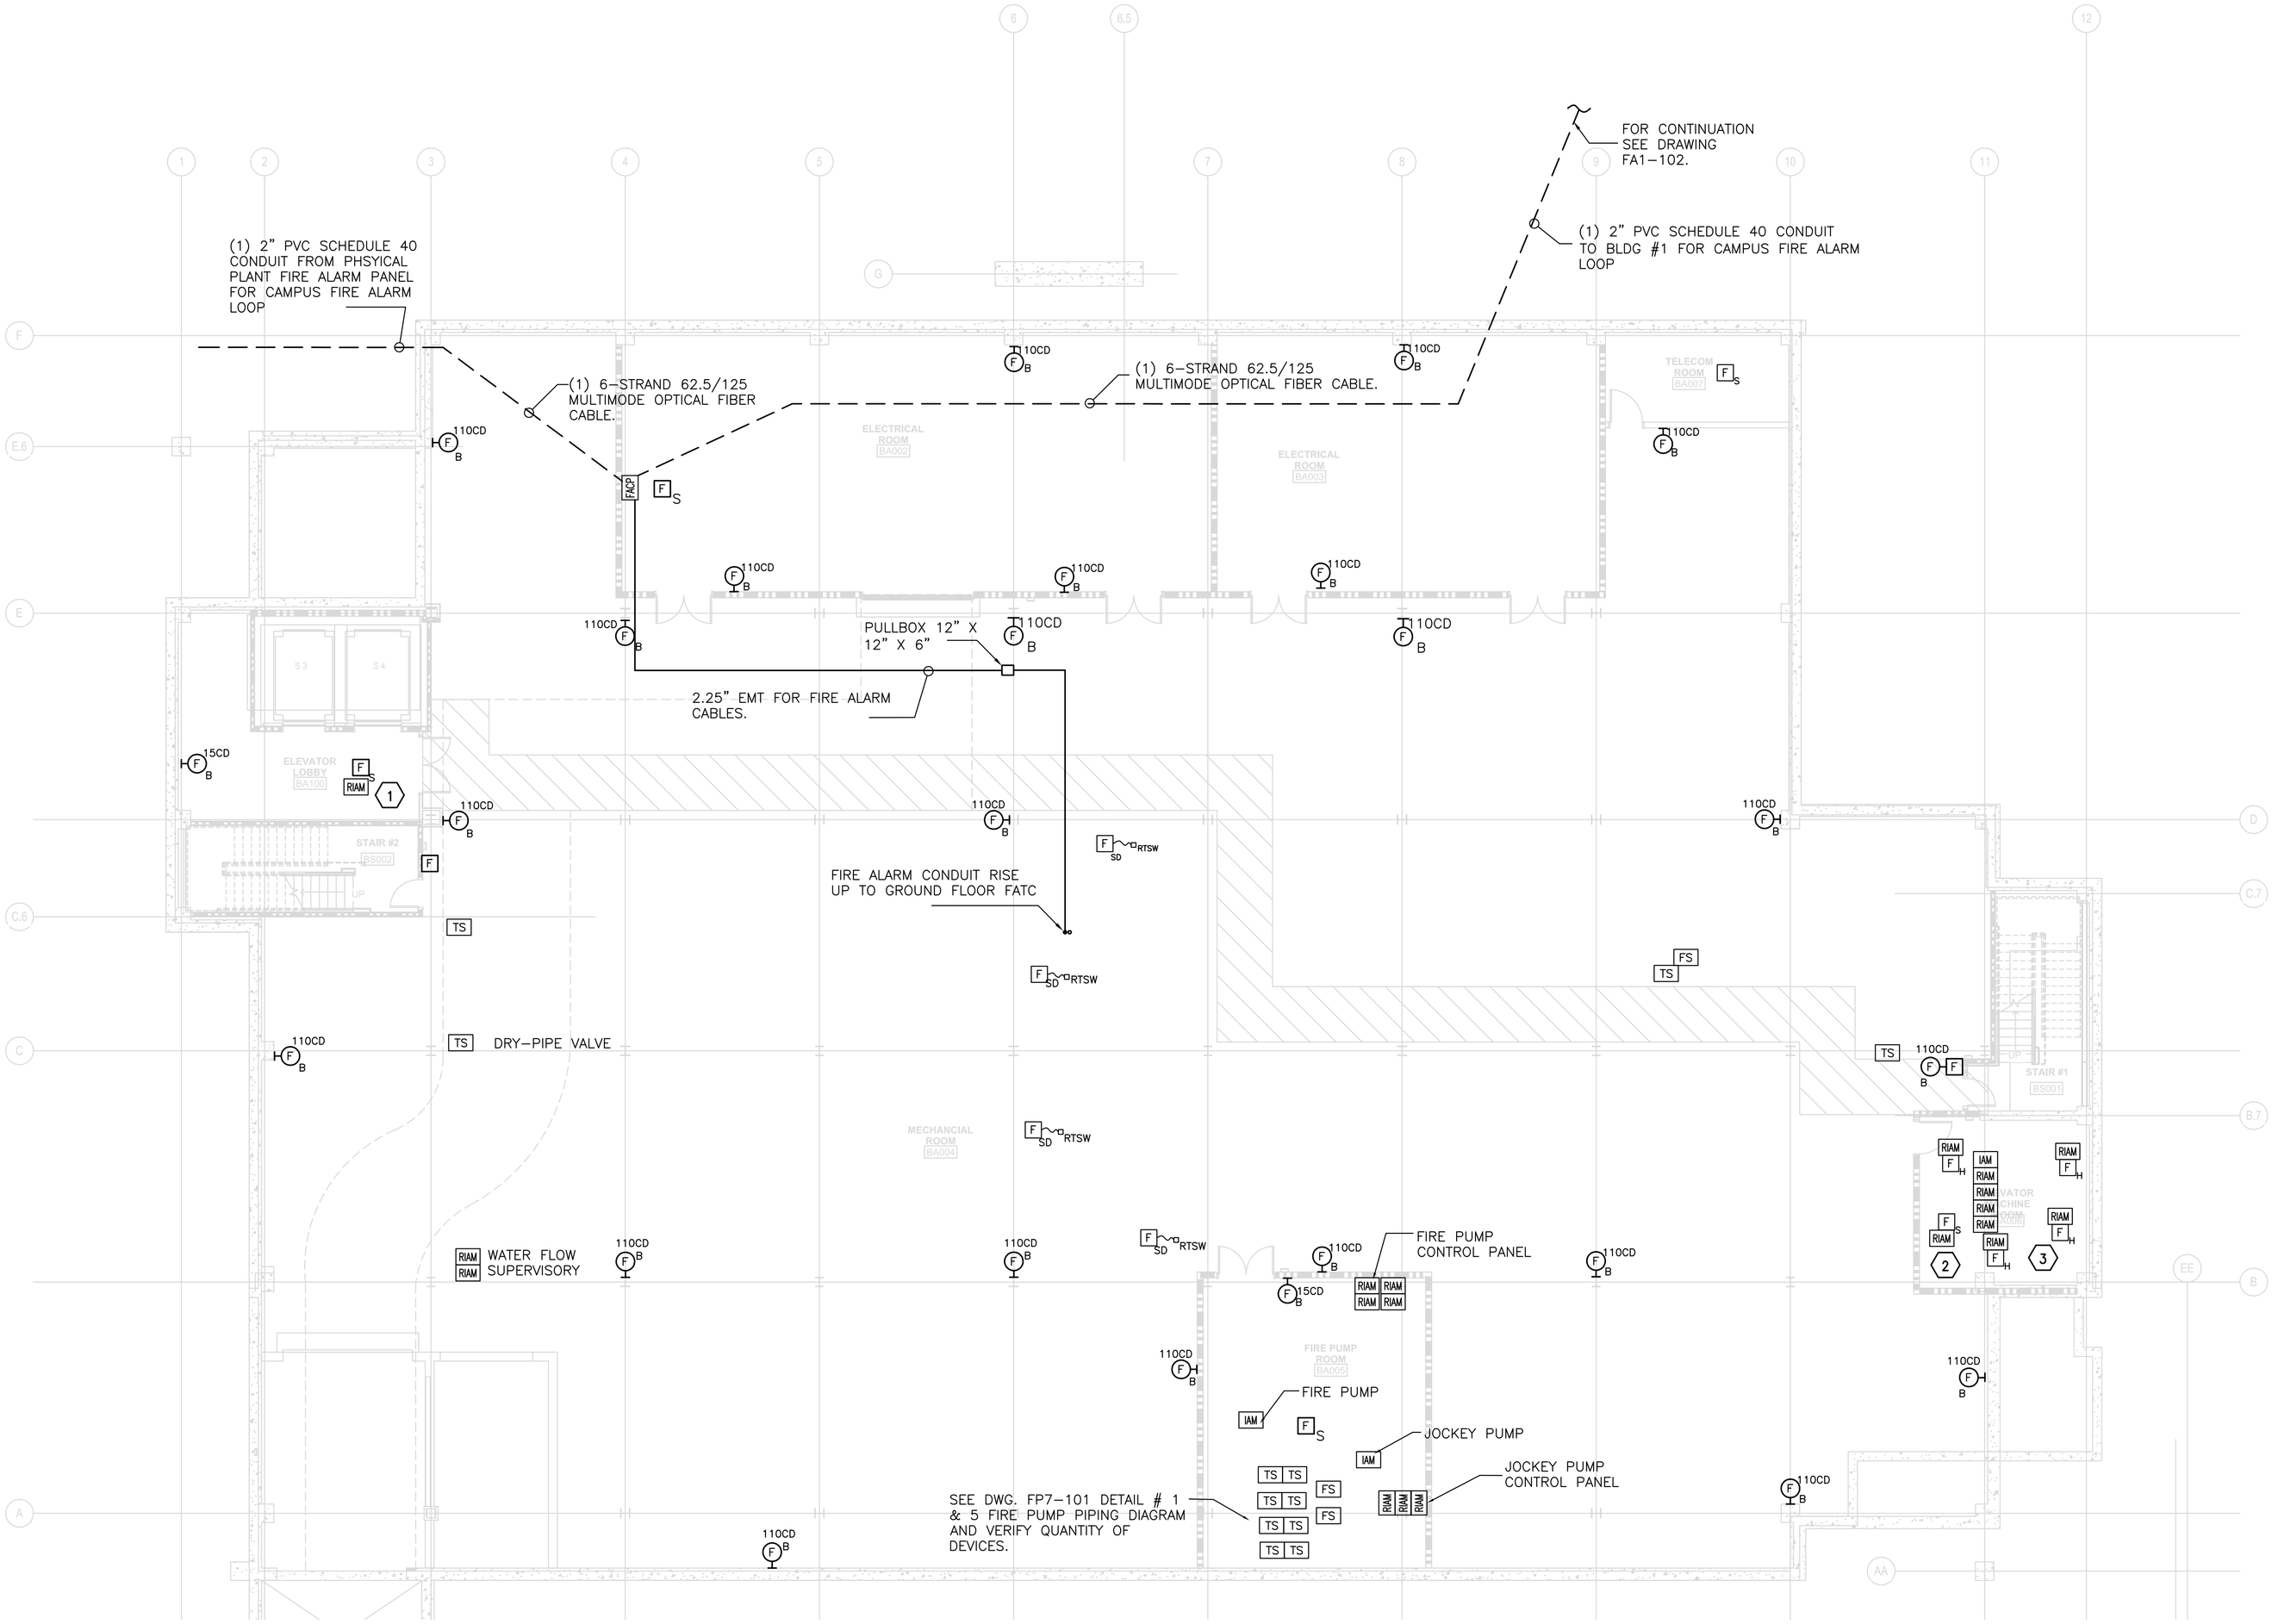

1 Fire Alarm - Basement Plan
SCALE: 1/8"=1'-0"

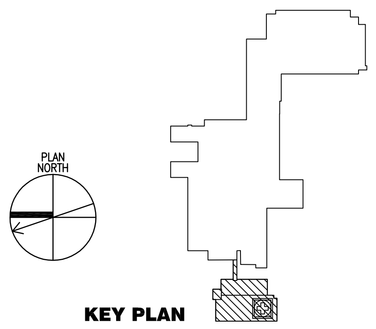

KEY PLAN

FOR CONSTRUCTION
FULLY SPRINKLERED

Revisions:	Date

CONSULTANTS:

HDR Architecture, Inc.
1101 King Street | Suite 400 | Alexandria, Virginia 22314-2944 | 703.518.8500

ARCHITECT/ENGINEERS:

ARCHITECTURE ENGINEERING INTERIOR DESIGN DESIGN/BUILD
ASTORINO
227 Fort Pitt Boulevard Pittsburgh Pennsylvania 15222
TEL 412 765 1700 FAX 412 765 1711 www.astorino.com

Drawing Title: **Fire Alarm Basement Plan - Alternate**

Approved: Project Director

Project Title: **VA CARES CONSOLIDATION VAMC, PITTSBURGH, PA RESEARCH OFFICE BLDG.**

Location: **VAPHS UNIVERSITY DRIVE**

Date: **08-18-10** | Checked: **REM** | Drawn: **JMG**

Project Number: **646CA2500R**

Building Number: **30**

Drawing Number: **FA1-101A**
Dwg. x of x

Office of Facilities Management
Department of Veterans Affairs

VA FORM 08–6231, OCT 1978