Key Notes

1. SMOKE DETECTOR WILL INITIATE THE ELEVATOR RECALL.

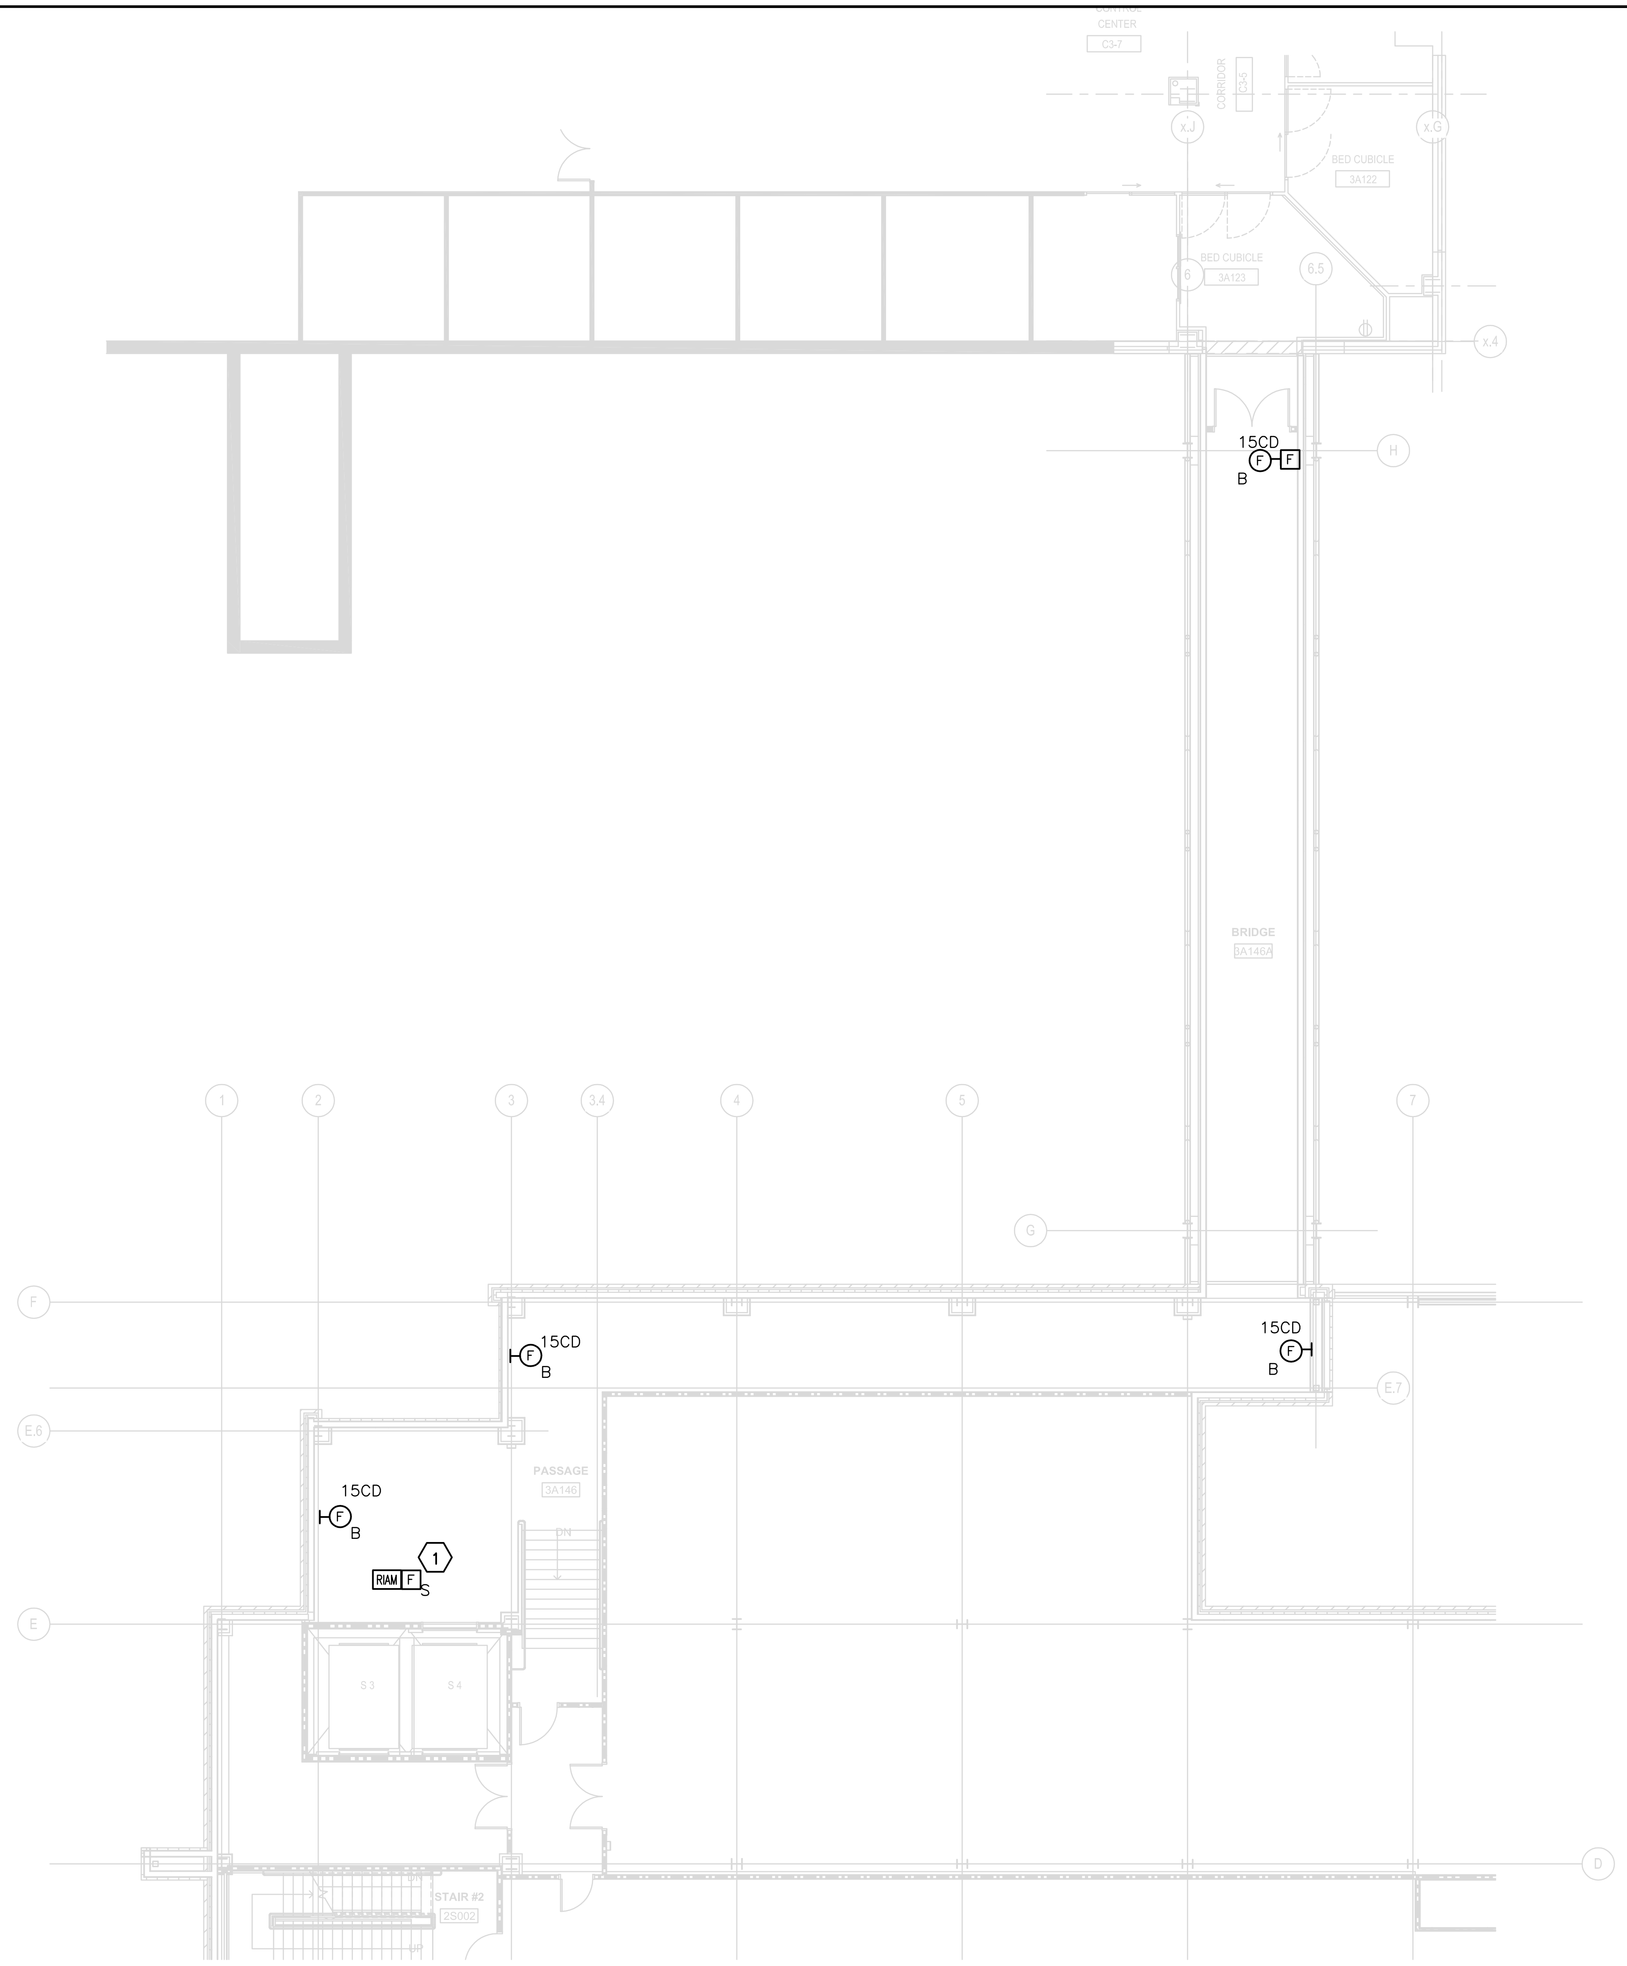

1 Fire Alarm - Bridge Plan
SCALE: 1/8"=1'-0"

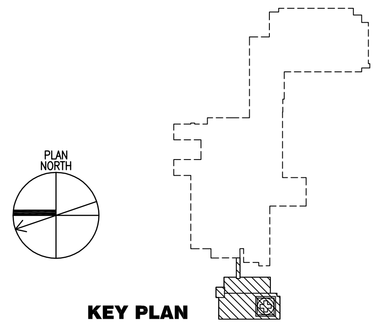

KEY PLAN

FOR CONSTRUCTION
FULLY SPRINKLERED

Revisions:	Date

CONSULTANTS:

HDR Architecture, Inc.
1101 King Street | Suite 400 | Alexandria, Virginia 22314-2944 | 703.518.8500

ARCHITECT/ENGINEERS:

ARCHITECTURE ENGINEERING INTERIOR DESIGN DESIGN/BUILD
ASTORINO
227 Fort Pitt Boulevard Pittsburgh Pennsylvania 15222
TEL 412 765 1700 FAX 412 765 1711 www.astorino.com

Drawing Title: **Fire Alarm Bridge Plan**

Approved: Project Director

Project Title: **VA CARES CONSOLIDATION VAMC, PITTSBURGH, PA RESEARCH OFFICE BLDG.**

Location: **VAPHS UNIVERSITY DRIVE**

Date: **08-18-10** | Checked: **REM** | Drawn: **JMG**

Project Number: **646CA2500R**

Building Number: **30**

Drawing Number: **FA1-132**
Dwg. -- of --

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

P:\Projects\2005425.00\CAD\UNIVERSITY DRIVE\Research Office Building\Electrical\FA1-132.dwg RMANN 06/09/10 13:41:09