Key Notes

1. PROVIDE 4' F04 FIXTURE RECESSED VERTICALLY IN WALL WITH TOP OF FIXTURE AT THE CEILING. PROVIDE 2' F04 FIXTURE RECESSED IN CEILING WITH END OF FIXTURE AT WALL IN LINE WITH VERTICALLY MOUNTED FIXTURE.

2. GRAFIK EYE LIGHTING CONTROL PANEL (QS3000).

PROVIDE 3 ADDITIONAL TYPE F27 FIXTURES WALL MOUNTED IN ELEVATOR HOISTWAY. FIXTURES TO BE SERVED FROM CIRCUIT LSGHA-7 AND SWITCHED IN MACHINE ROOM.

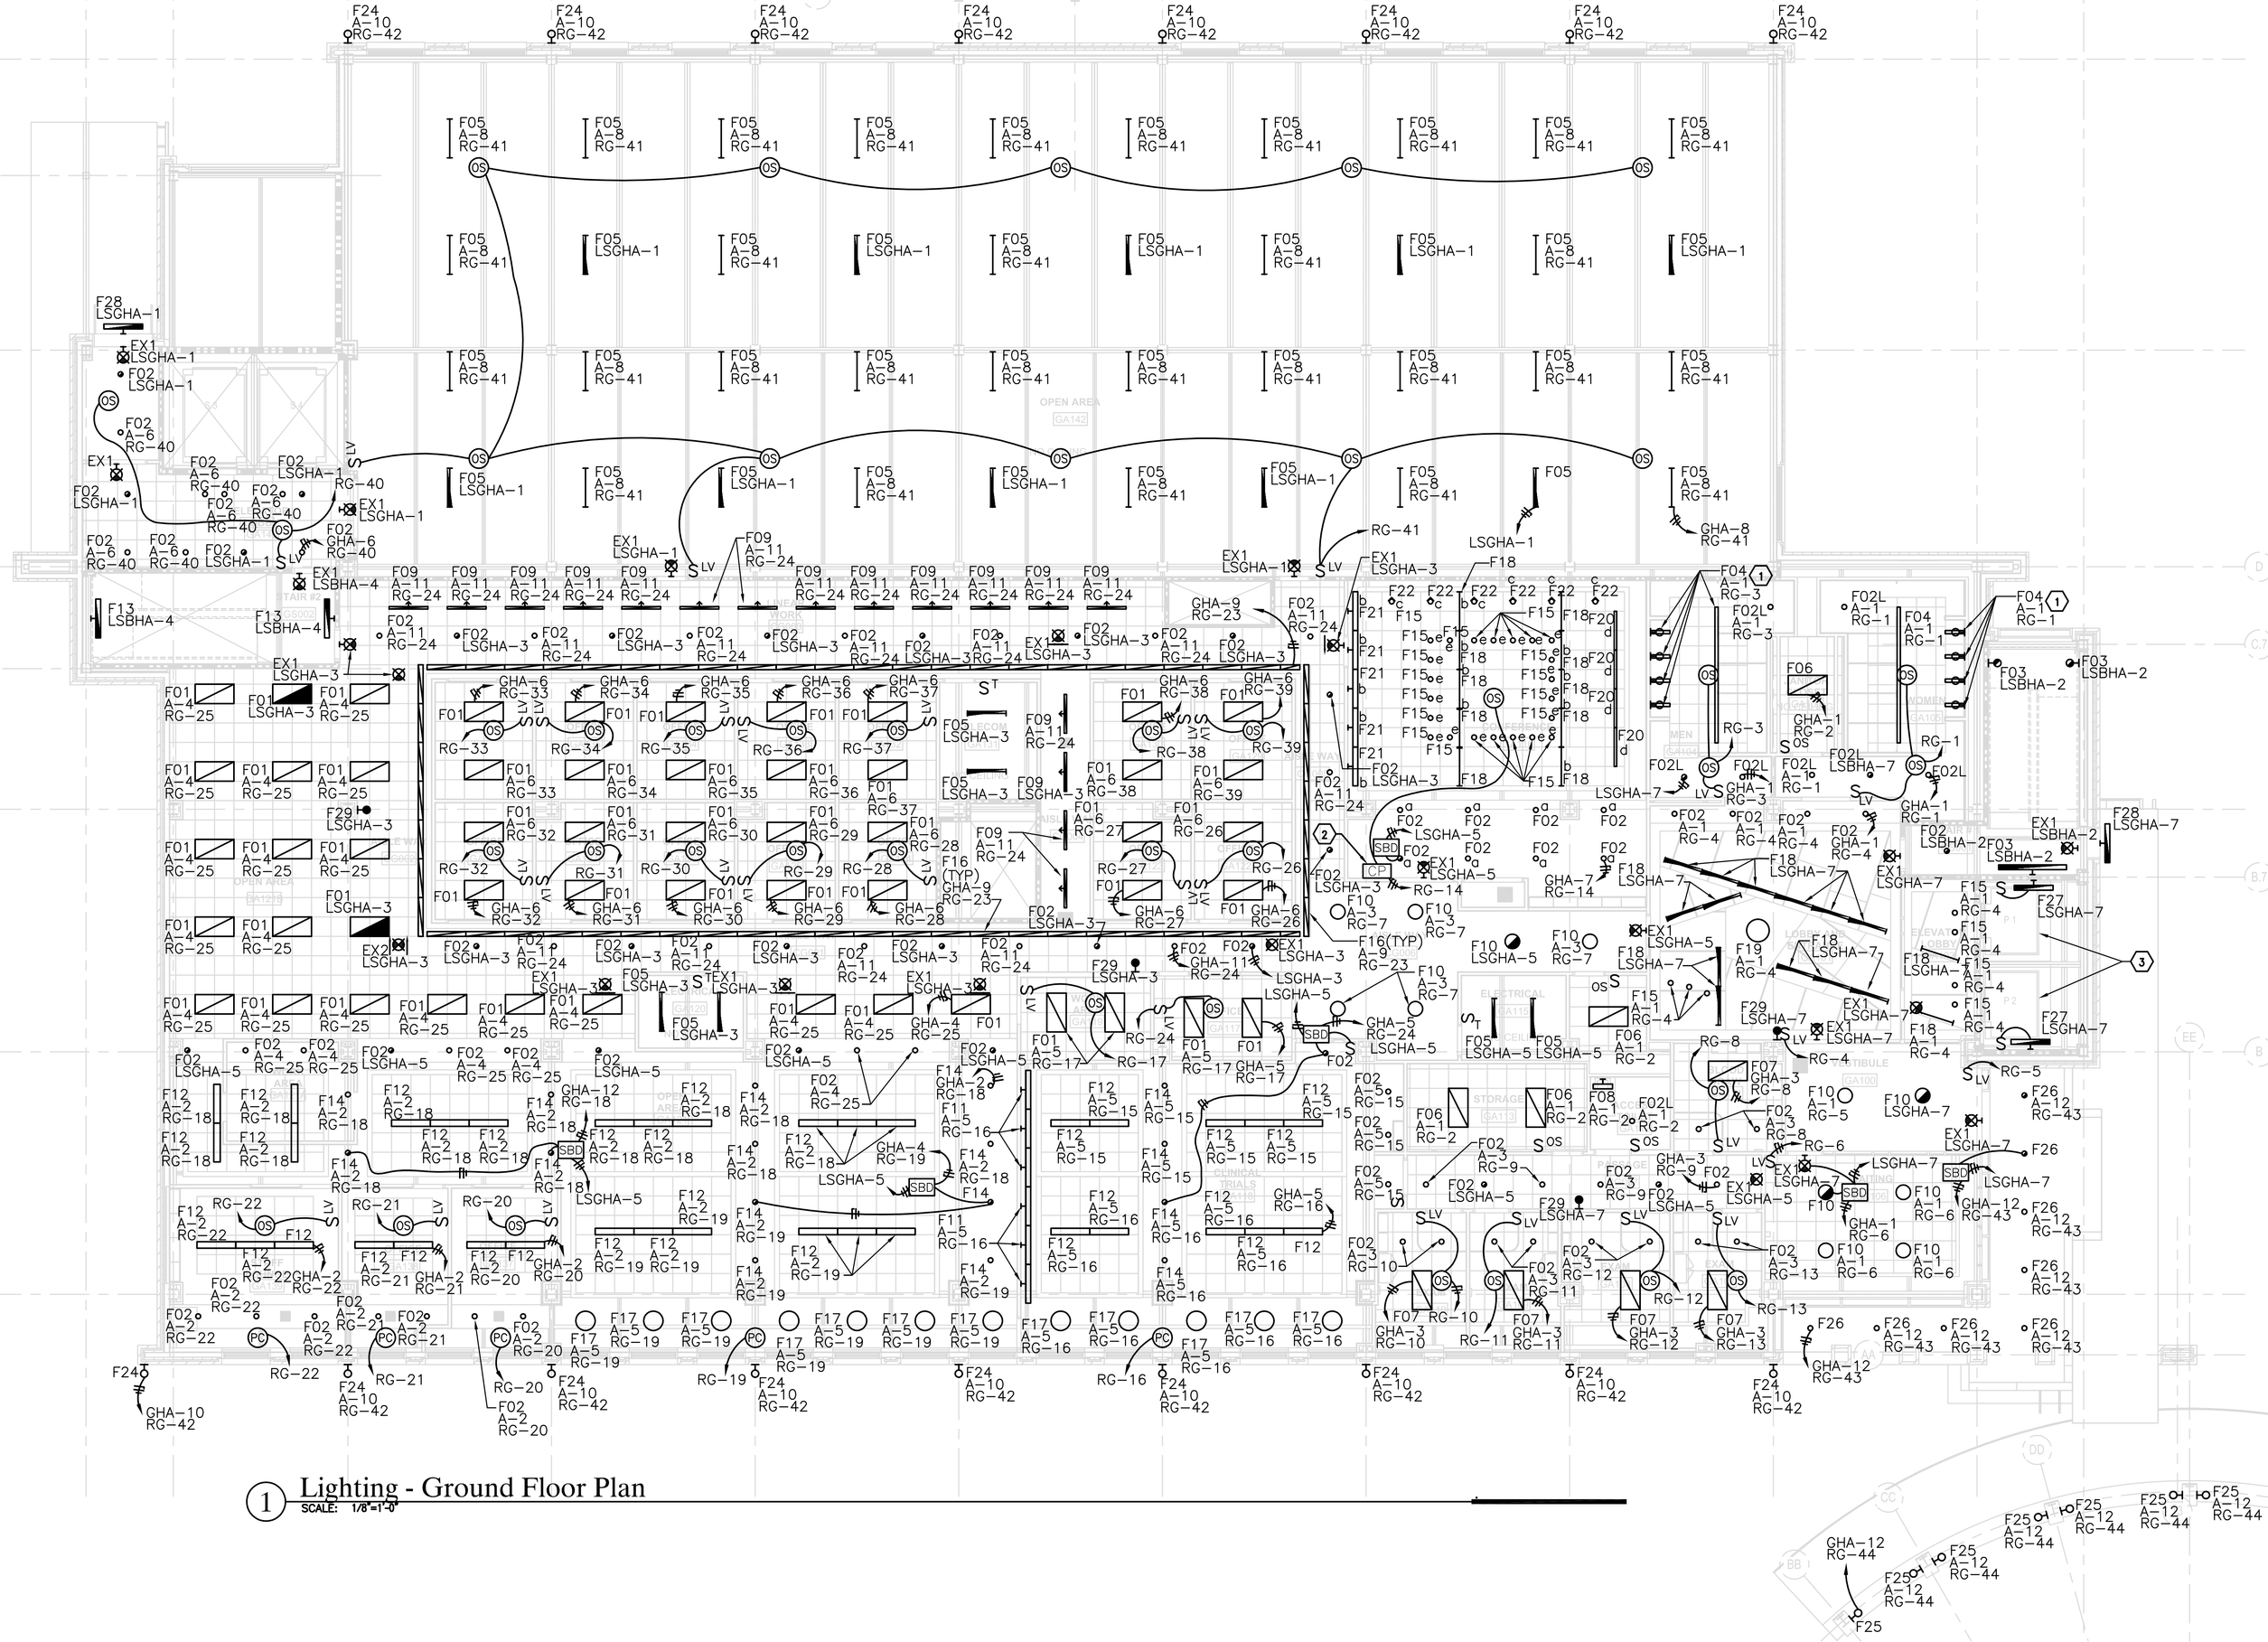

1 Lighting - Ground Floor Plan
SCALE: 1/8"=1'-0"

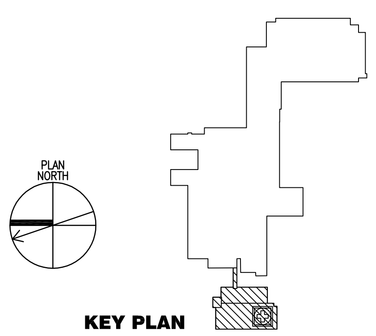

KEY PLAN

FOR CONSTRUCTION
FULLY SPRINKLERED

CONSULTANTS:

HDR Architecture, Inc.
1101 King Street | Suite 400 | Alexandria, Virginia 22314-2944 | 703.518.8500

ARCHITECT/ENGINEERS:

ARCHITECTURE ENGINEERING INTERIOR DESIGN DESIGN/BUILD
ASTORINO
227 Fort Pitt Boulevard Pittsburgh Pennsylvania 15222
TEL 412 765 1700 FAX 412 765 1711 www.astorino.com

Revisions:	Date

Drawing Title: **Lighting Ground Floor Plan**

Approved: Project Director

Project Title: **VA CARES CONSOLIDATION VAMC, PITTSBURGH, PA RESEARCH OFFICE BLDG.**

Location: **VAPHS UNIVERSITY DRIVE**

Date: **08-18-10** | Checked: **TMR** | Drawn: **DRS**

Project Number: **646CA2500R**

Building Number: **30**

Drawing Number: **EL1-111**
Dwg. -- of --

Office of Facilities Management
Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

P:\Project\2005425.00\CAD\UNIVERSITY DRIVE\Research Office Building\Electrical\EL1-111.dwg SSTROBEL 08/18/10 - 13:59:17