DESIGNER NOTES:

1. PROJECT DESIGN AND FLOW DIAGRAM SHALL BE IN CONFORMANCE WITH SPECIFICATIONS.
2. SHOW VALVES THREADED OR FLANGED TO SUIT THE PROJECT.
3. ENGINEERING NOTES FOR MPS DISTRIBUTION PRV ARE TYP. FOR ALL PRVS.
4. PRIMARY ELEMENT LOCATIONS SHALL CONFORM TO REQUIREMENTS OF INSTRUMENT MANUFACTURER.
5. DELETE "DESIGNER NOTES" FROM PROJECT DRAWINGS WHEN COMPLETED.
6. SHOW ALL PIPE SIZES.
7. DO NOT SCHEDULE BOILER SAFETY VALVES.
8. DO NOT SIZE VENT PIPES FROM BOILER SAFETY VALVES. CONTRACTOR MUST DO THIS BASED ON VALVES FURNISHED.

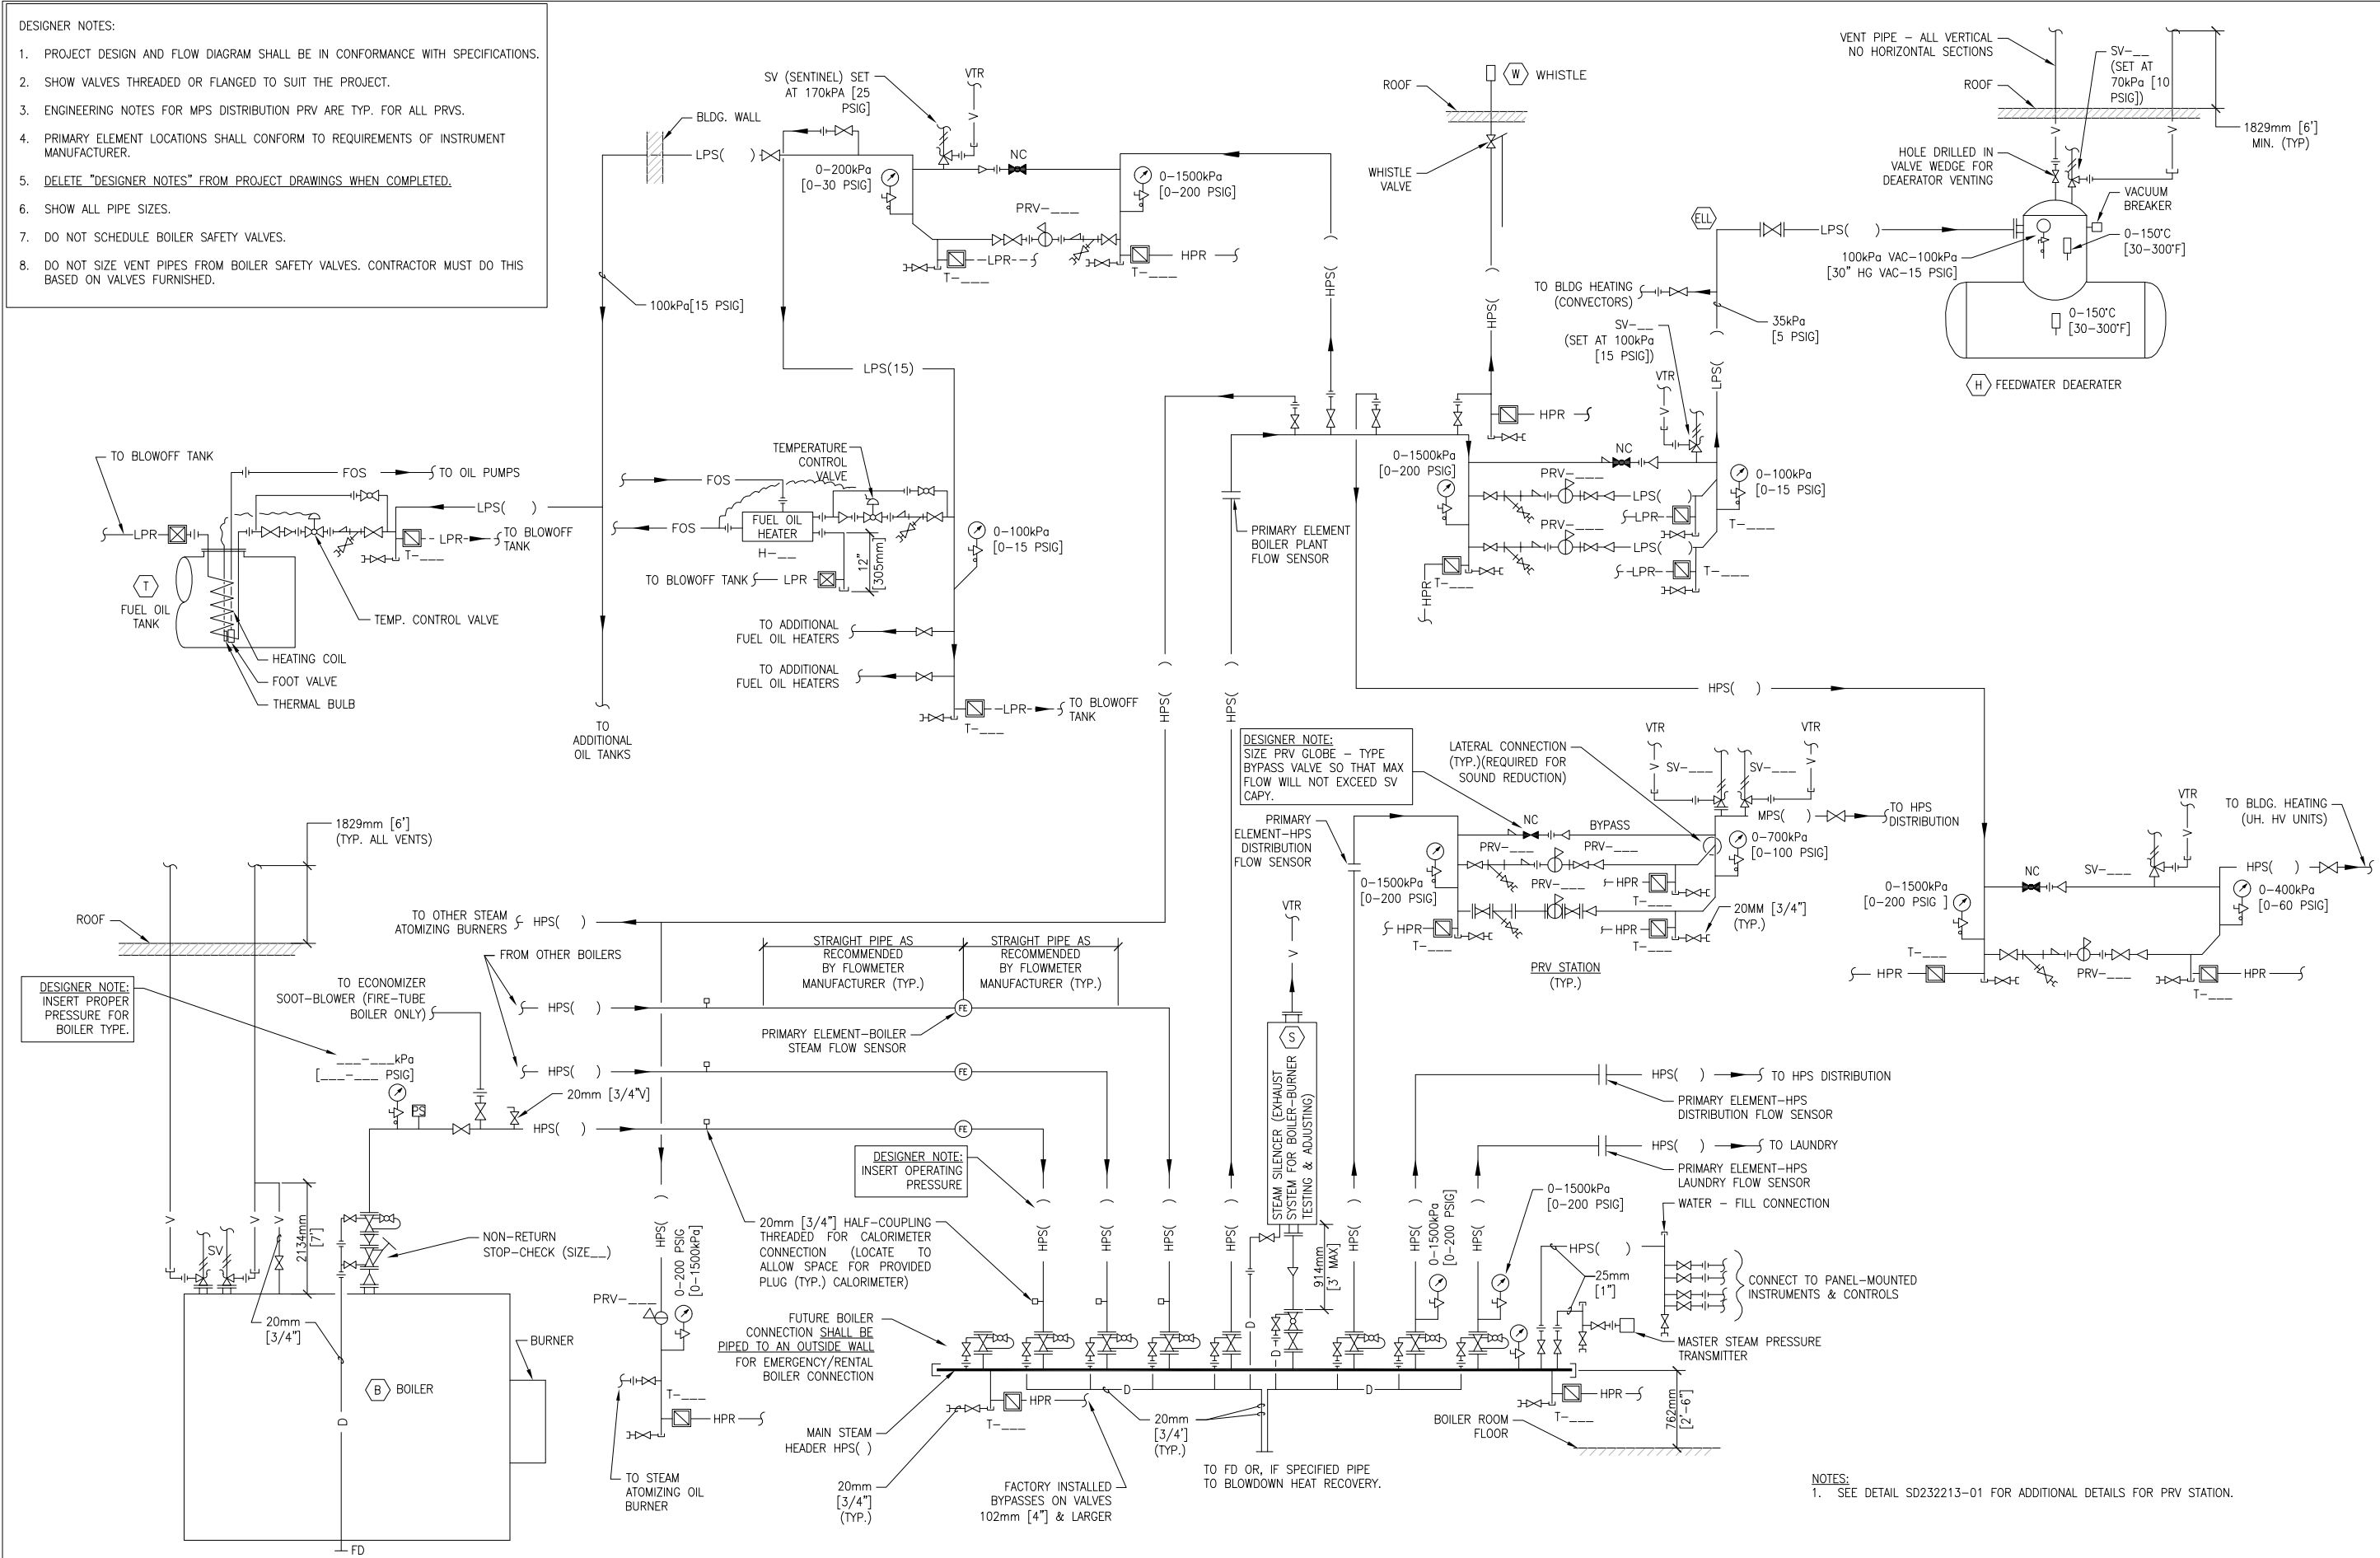

NOTES:
1. SEE DETAIL SD232213-01 FOR ADDITIONAL DETAILS FOR PRV STATION.

STANDARD STEAM BOILER PLANT PIPING DIAGRAM

NTS

DETAIL TITLE / STANDARD STEAM BOILER PLANT PIPING DIAGRAM

SCALE: NONE

DATE ISSUED: NOVEMBER 1, 2020

SD232111-03.DWG

U.S. Department of Veterans Affairs

VA